



# High-Performance Packaged Boiler

Australia's largest certified  
package boiler company.



**The Environmental  
Group Limited**  
*Engineering a Sustainable Future*

The Environmental Group Limited

[www.environmental.com.au](http://www.environmental.com.au)

# Working across the Circular Economy

## Our Purpose

Engineering a sustainable future.

## Our Mission

To enable our clients to contribute to a cleaner environment by safely delivering pivotal solutions while generating value for our shareholders, staff, and partner industries.

## Our Team

Our local experts are dedicated to reducing waste and boosting energy performance. Trusted worldwide to provide the highest standards of service and support.

# Tomlinson Energy Services

*Part of The Environmental Group*


Tomlinson Energy Services is Australia's leading provider of packaged boiler solutions, delivering the highest combustion efficiency to keep operating costs low and performance high.

We specialise in custom design, installation, commissioning, and national servicing and repairs, complemented by our 24/7 emergency support.

With offices and a dedicated service team across Australia, Tomlinson Energy Services ensures boilers operate at peak performance for maximum efficiency and reliability.



# WM-G10 ZM-PLN AND WM-G20 ZM-PLN MONARCH® BURNERS (85–3000 KW)

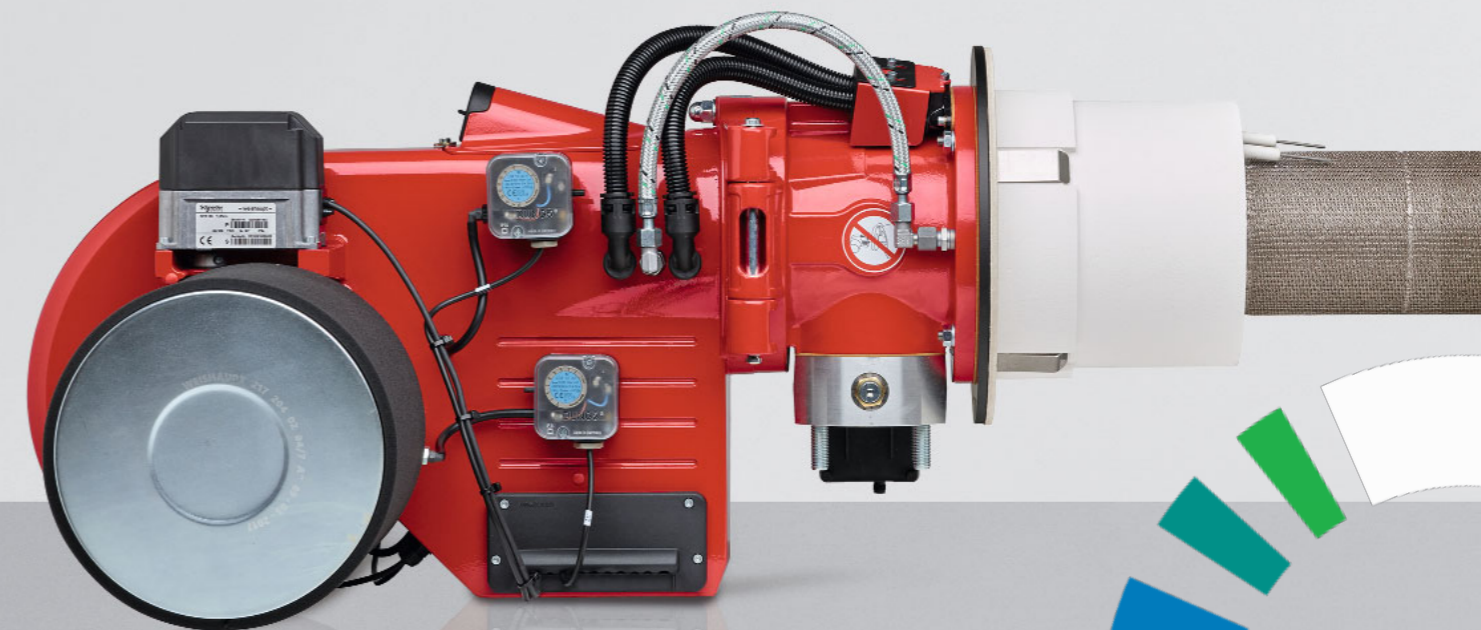

–weishaupt–

# Offering Industry Leading Burners

**Weishaupt** produces gas and oil-fired boilers, heat pumps, and burners. These top-quality products are characterised by their meticulous development, high-quality workmanship, outstanding operational reliability, and maximum Efficiency. Their unrivalled excellence extends equally to design and function.

## A new class of emissions: Ultra-Low NO<sub>x</sub>




*Test-firing chambers for medium and large-sized burners at the Weishaupt Research & Development Centre*

For more than six decades, Weishaupt's monarch® series burners have been used on a wide variety of heat generators and industrial plant, and their success has helped underpin Weishaupt's outstanding reputation.


Their PLN-version burners stand ready for use in situations where the very lowest of emission levels are being demanded. PLN stands for Premix Low NO<sub>x</sub> – a system that combines premixing with surface-stabilised combustion.

A further advantage of this type of combustion system is that it can be used on appliances with particularly small combustion chambers, as well as with more typical boilers.


*Homogeneous, surface-stabilised combustion*

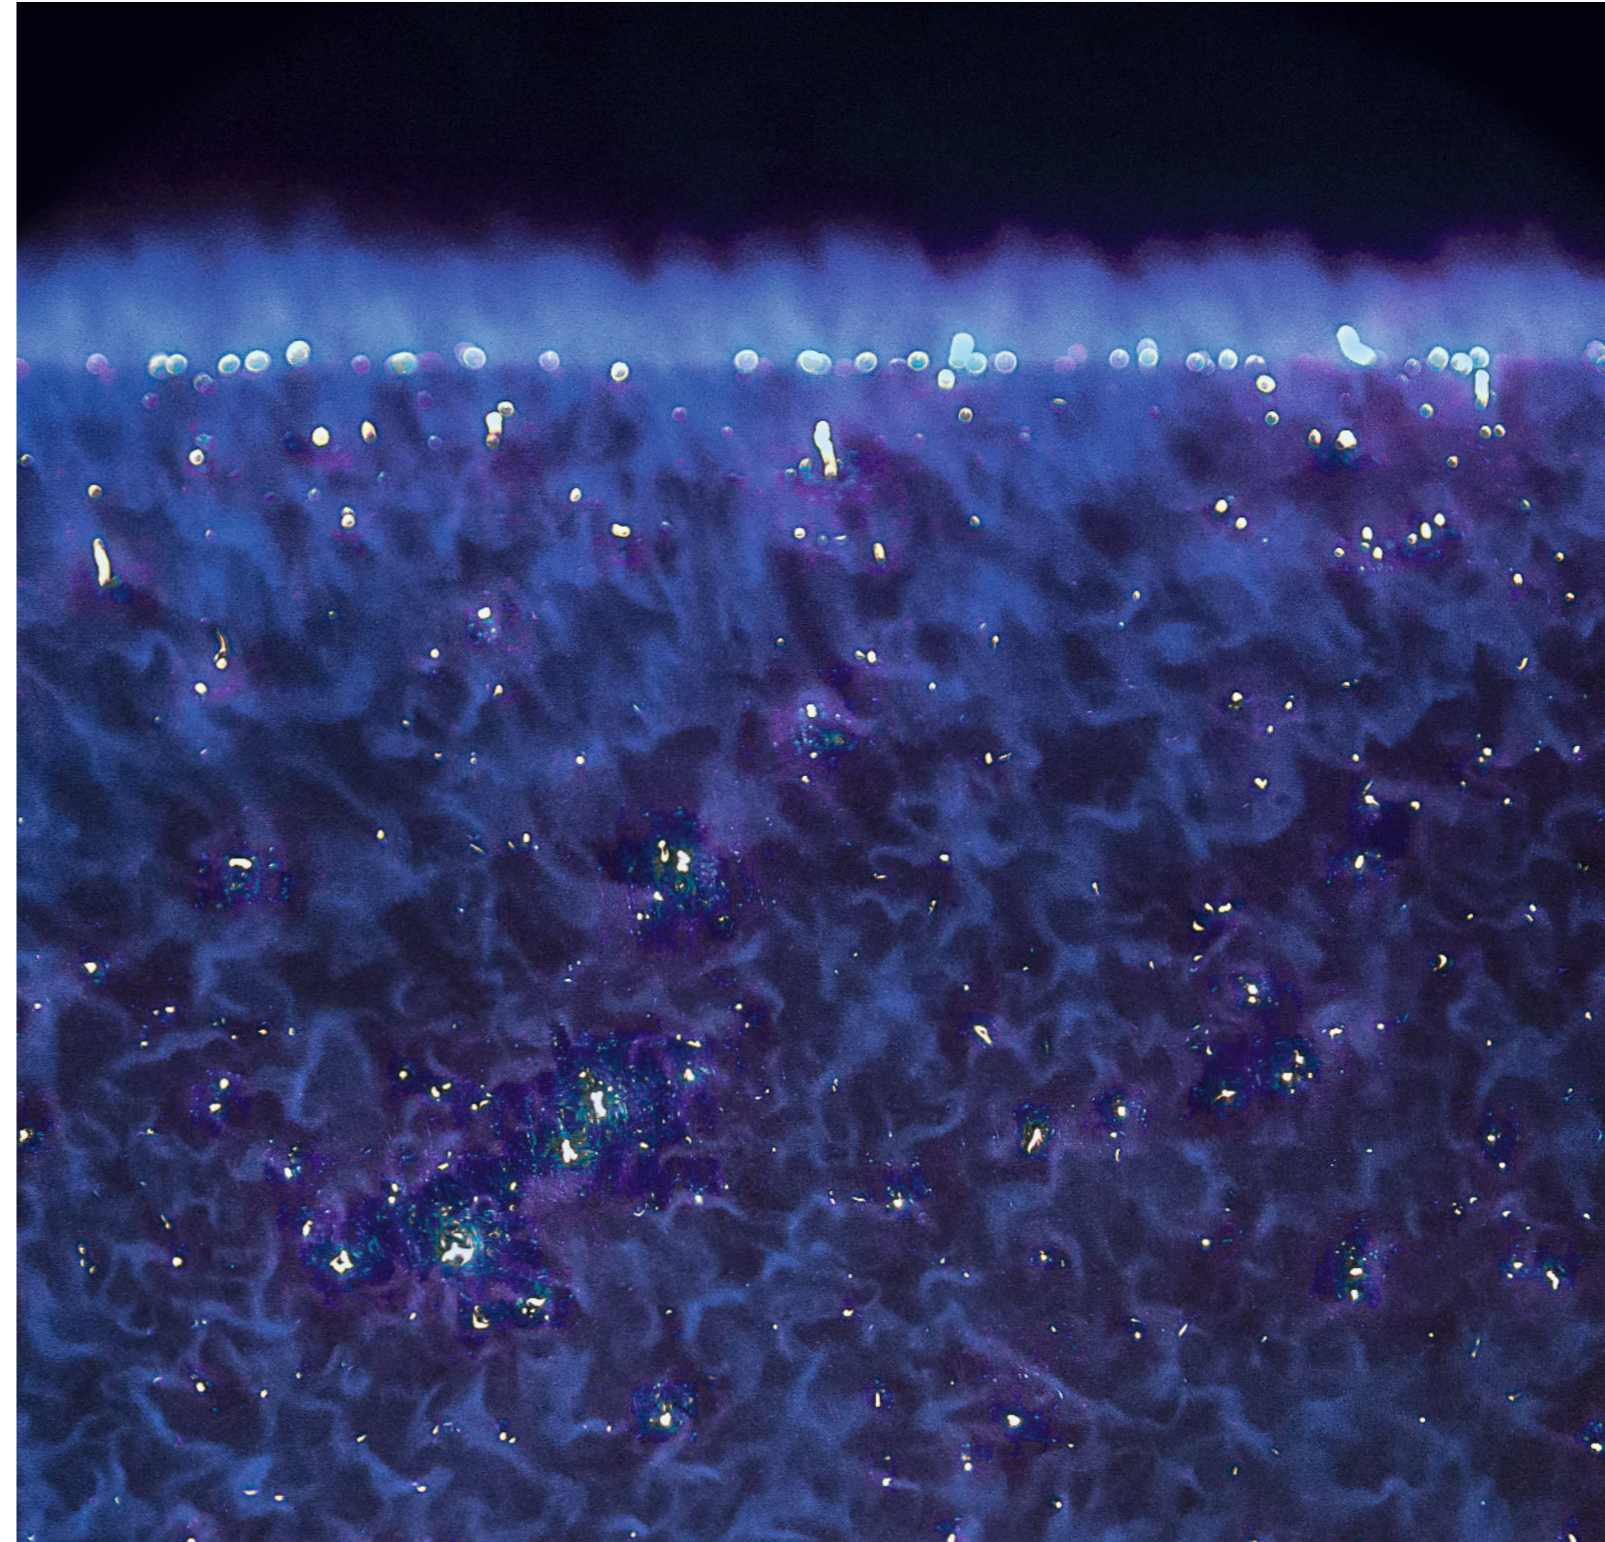

## Weishaupt premix technology for extremely low NO<sub>x</sub> emission limits

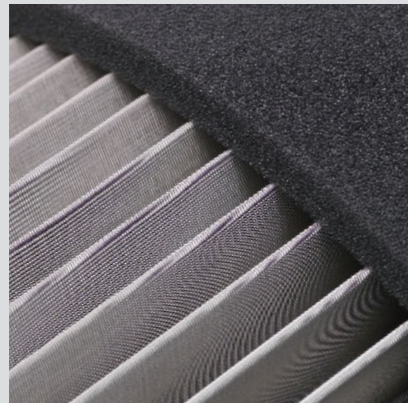

The metal gauze air filter is protected from dust by an additional pre-filter sleeve

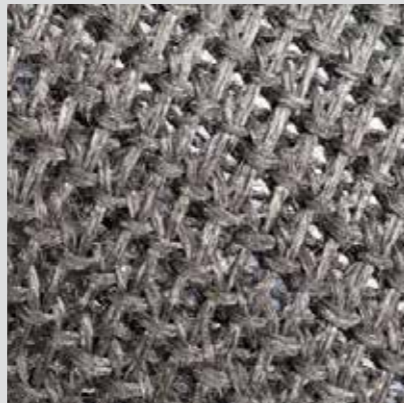

A microweave mat made from a high-quality alloy permits the right amount of gas / air mix to pass



Weishaupt PLN-version burners can also be used in very small combustion chambers

Everywhere in the world, emission limits are becoming ever tighter, with a focus on NO<sub>x</sub> emissions in particular. Weishaupt has therefore developed a new generation of burners designed to fulfil these demands.

Weishaupt burners have always been particularly efficient and environmentally friendly. Premix engineering is used to achieve NO<sub>x</sub> emissions below 30 mg/kWh.

Premixing followed by surface-stabilised combustion has been state of the art for many years in small condensing boilers. It is environmentally friendly, reliable, and efficient. Extending these benefits to typical heat generators with larger outputs was the developmental goal for the PLN-version burners.

### Special gas / air mix

Stabilised surface combustion relies on an homogeneous gas / air mixture. For that reason, a completely new mixing assembly was developed for the PLN-version burners. A key feature is the separated gas and air feeds, with the two media not being brought together before the burner tube. There, a uniform mix is produced from the gas flowing out through the distributor and the combustion air that has been set in rotation by the swirl plate.

### Stabilised surface combustion


The gas / air mix, which is under pressure, permeates the microweave alloy mat and combusts at its surface. The flame carpet thereby created has flame temperatures below 1200 °C and so the formation of thermal NO<sub>x</sub> is inhibited. NO<sub>x</sub> emission levels below 30 mg/kWh are now also a reality for medium-capacity burners.

One substantial benefit of this technology is to be found in the combustion chamber requirements. These can be considerably smaller than those found in typical boilers.


Weishaupt's PLN-version premix burners also have similar turndowns to their forced-draught stablemates. The electronic compound regulation provided by the W-FM50, W-FM 100 and W-FM200 combustion managers can achieve turn-down ratios of 7:1 with these burners.




## Safety first

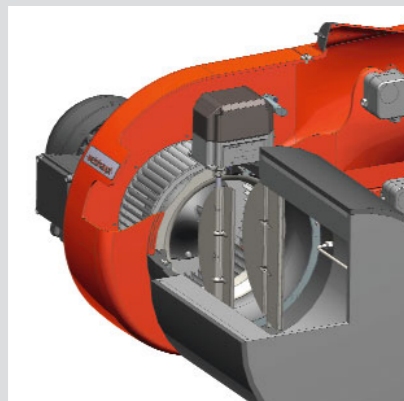

The air damper control has been designed to be particularly aerodynamic

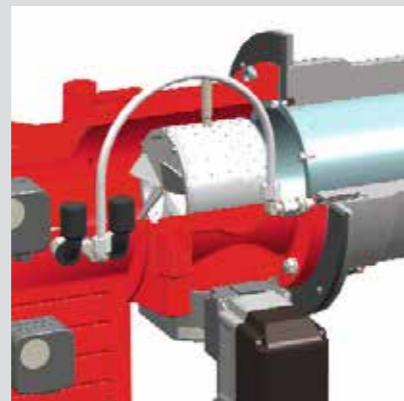

The special mixing of gas and air is conducive to reliable ignition behaviour

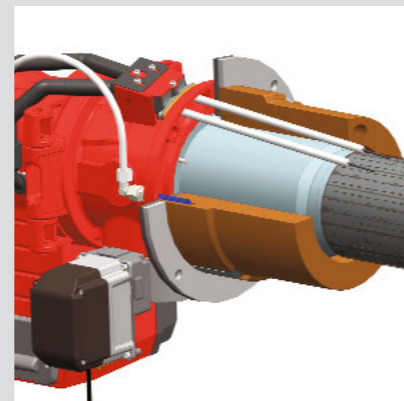

A ceramic insulator provides optimal heat shielding to the mixing assembly and electrode unit

### Clean combustion air

The combustion surface's alloy microweave mat is only able to distribute the gas/air mixture evenly if its pores are not blocked by particles. Weishaupt therefore employs a special metal gauze air filter. An additional pre-filter sleeve is used to keep larger dust particles at bay. This sleeve can be washed or replaced as required.

### Ignition and monitoring

The ignition electrode and the ionisation electrode are brought together as a monitoring unit. The electrodes are fed through the insulator to protect them from the heat and are also air cooled.

### Optimal safety and reliability

The PLN-version burners are especially equipped with two monitoring systems. An ionisation electrode monitors the combustion surface, while an infra-red flicker detector secures the premix chamber and the burner tube.

### Uninterrupted monitoring

The air volume, and thus the cleanliness of the air filter, is continuously monitored during burner operation by an additional air pressure switch. The necessary air volume is thereby always guaranteed.

### Thermal insulators


Thermal protection of the premix chamber, which contains the flammable gas/air mixture, is a safety-critical aspect of PLN-version burners.

Conscious of their importance, Weishaupt has developed precisely tailored insulators that are suited to the thermal conditions. They provide optimal protection against uncontrolled heat influences in this very sensitive area.

An insulator designed for temperatures up to 850 °C is suitable for burners used on low-temperature hot-water boilers with through-pass or three-pass combustion chambers.

Boilers with a reverse-flame combustion chamber,<sup>1)</sup> steam boilers, and thermal fluid heaters will place a considerably higher demand on the insulator. Weishaupt offers a high-temperature ceramic insulator for such plant, providing optimal protection for temperatures up to 1200 °C.






<sup>1)</sup> The use of PLN-version burners on boilers with reverse-flame chambers requires OEM approval.

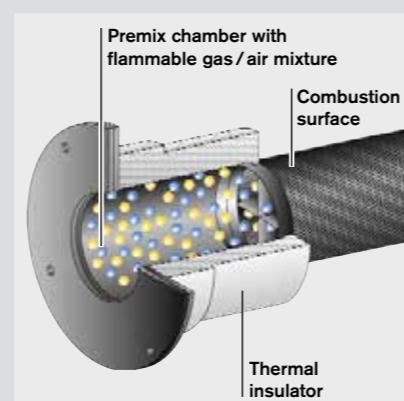

## Simple installation, easy servicing

### The burner is installed in five easy steps:

1. Installation of the ceramic insulator.
2. Checking of the insertion depth and insulation of the aperture between the burner and the refractory
3. Mounting of the hinged flange.
4. Insertion of the combustion surface (optional installation aid available)
5. Attachment of the burner to the hinged flange.

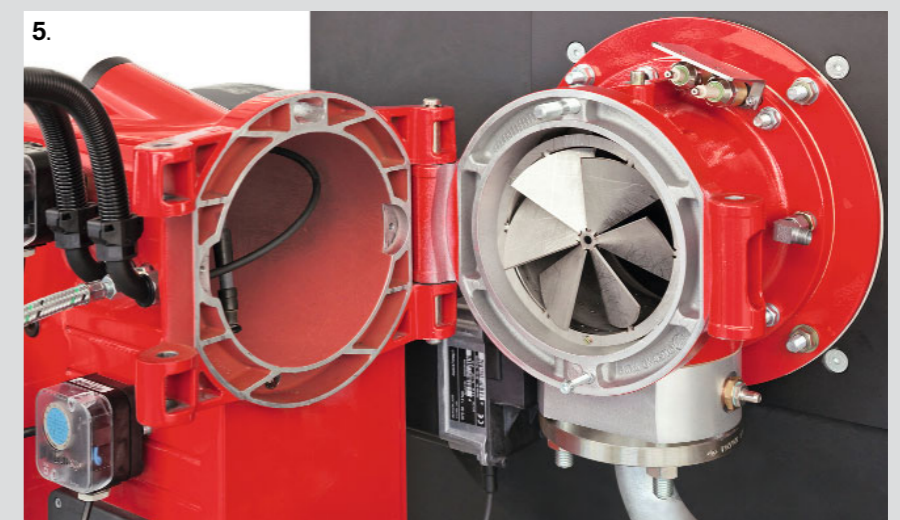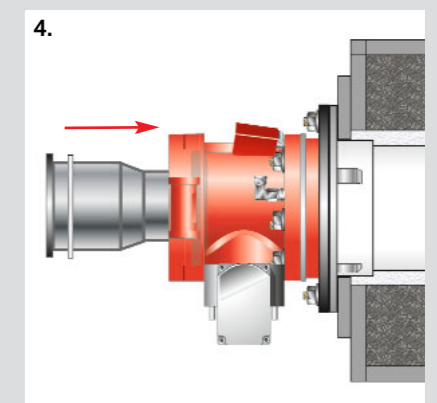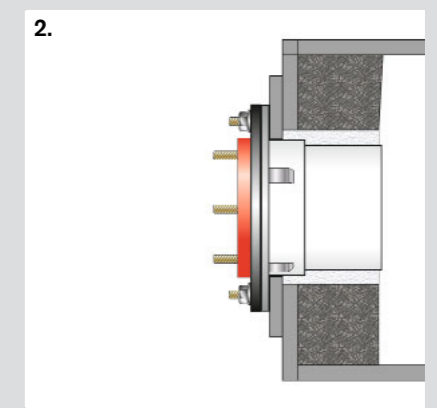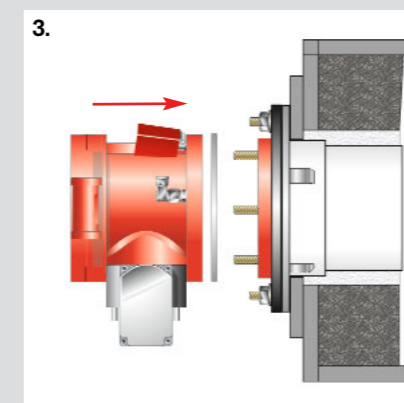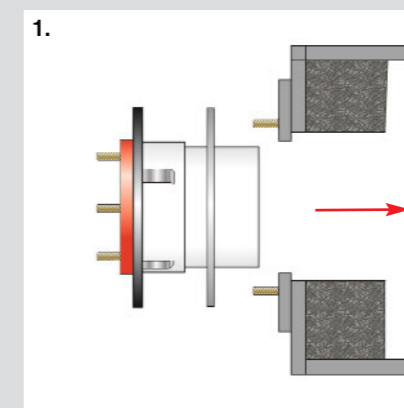

The burner hinges a full 90°, enabling the combustion surface to be withdrawn through the mounted flange

# Specification, control, and model designation

## Fuels

Natural gas  
LPG

The suitability of fuels of differing quality must be confirmed in advance with Weishaupt.

## Applications

Weishaupt PLN-version burners are suitable for intermittent firing and continuous firing on:

- EN 303-compliant heat generators
- LTHW boilers
- HTHW boilers < 130 °C
- Steam boilers <sup>1)</sup>
- Air heaters < 100 °C
- Thermal fluid heaters <sup>1)</sup>
- Certain process applications <sup>1)</sup>

## Permissible ambient conditions

- Ambient temperature -15 to + 40 °C
- Maximum 80 % relative humidity, no condensation
- The combustion air must be free of aggressive substances (halogens, chlorides, fluorides etc.) and impurities (dust, debris, vapours, etc.)
- Adequate ventilation is required for operation in enclosed spaces
- For plant in unheated areas, certain further measures may be required

Use of the burner for other applications or in ambient conditions not detailed above is not permitted without the prior written agreement of Max Weishaupt GmbH. Service intervals will be reduced in accordance with the more extreme operational conditions.

## International Protection rating

IP 54 per EN 60529.

## Standards compliance

The burners are tested by an independent body and fulfil the applicable requirements of the following European Union directives and applied standards:

### EMC EMC Directive

2014/30/EU

Applied standards:

- EN 61000-6-1 : 2007
- EN 61000-6-2 : 2005
- EN 61000-6-4 : 2007

### LVD Low Voltage Directive

2014/35/EU

Applied standards:

- EN 60335-1 : 2010
- EN 60335-2-102 : 2010

### MD Machinery Directive

2006/42/EC

Applied standards:

- EN 267 Annex J,
- EN 676 Annex J,

### GAR Gas Appliances Regulation

2016/426/EU

Applied standards:

- EN 676 : 2008

### PED<sup>2)</sup> Pressure Equipment Directive

2014/68/EU

Applied standards:

- EN 267 Annex K,
- EN 676 Annex K,
- Conformity assessment procedure: Module B

The burners are labelled with

- CE Mark,
- CE-PIN per 2009/142/EC
- Identification No. of the notified body

## Control

Weishaupt PLN-version burners are suitable for gas firing, and for sliding-two-stage or modulating operation, depending on the method of load control employed.

The output of a modulating burner is matched – within its operating range – to current heat demand. That makes the burner suitable for a wide range of applications.

## Installation position

The burner is suitable for horizontal and vertical mounting on the heat generator. The manufacturer's instructions should be observed.

<sup>1)</sup> Please enquire.


<sup>2)</sup> With the appropriate choice of equipment.

## Gas-fired operation


### Sliding-two-stage control

Two-term switching (e.g. temperature or pressure stat) causes actuators to drive the burner to partial load or full load in response to heat demand. Combustion remains CO-free between load points

### Sliding-two-stage

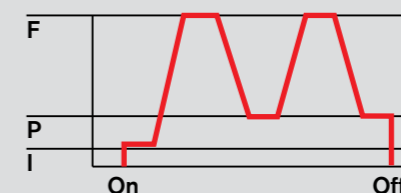

### Control <sup>1)</sup>

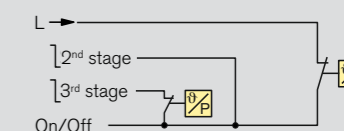

### Modulating control



An electronic load controller causes actuators to make infinitely variable load adjustments in response to heat demand.

Available modulation control options:

- W-FM50 with an optional separate load controller
- W-FM 100 with an optional integral load controller
- W-FM200 with its standard integral load controller

Alternatively, a PID controller can be fitted into the control panel.


### Modulating

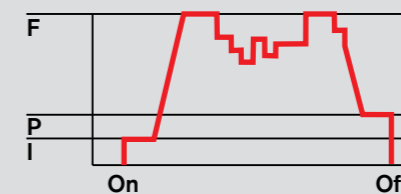

F = Full load (nominal load)  
P = Partial load (minimum load)  
I = Ignition load

<sup>1)</sup> Alternatively, staged load control can also be effected by an electronic PID controller, in which case appropriate temperature sensors or pressure transducers will be required.

## Model designation

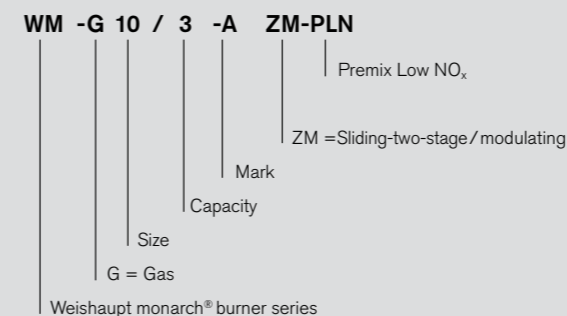

# Digital combustion management: Efficient and reliable


**Digital combustion management means optimal combustion figures, continuously reproducible setpoints, and ease of use.**

Weishaupt PLN-version gas burners are equipped as standard with electronic compound regulation and digital combustion management. The latest combustion technologies demand a precise and continually reproducible dosing of fuel and combustion air. This optimises combustion efficiency and saves fuel.

### Simple operation


Setting and control of the burner is achieved using the control and display unit. This is linked to the combustion manager via a bus system, enabling the user-friendly setting of the burner. The control and display unit has, depending on the type of combustion manager employed, either a language-neutral display or a clear text display with a choice of languages. An English/Chinese dual-screen version is available as an option with the latter should a Chinese-character display be desired.

**Variable speed drive** reduces electrical consumption and facilitates a soft start of the combustion air fan. The use of VSD will also reduce noise emissions by a considerable amount.


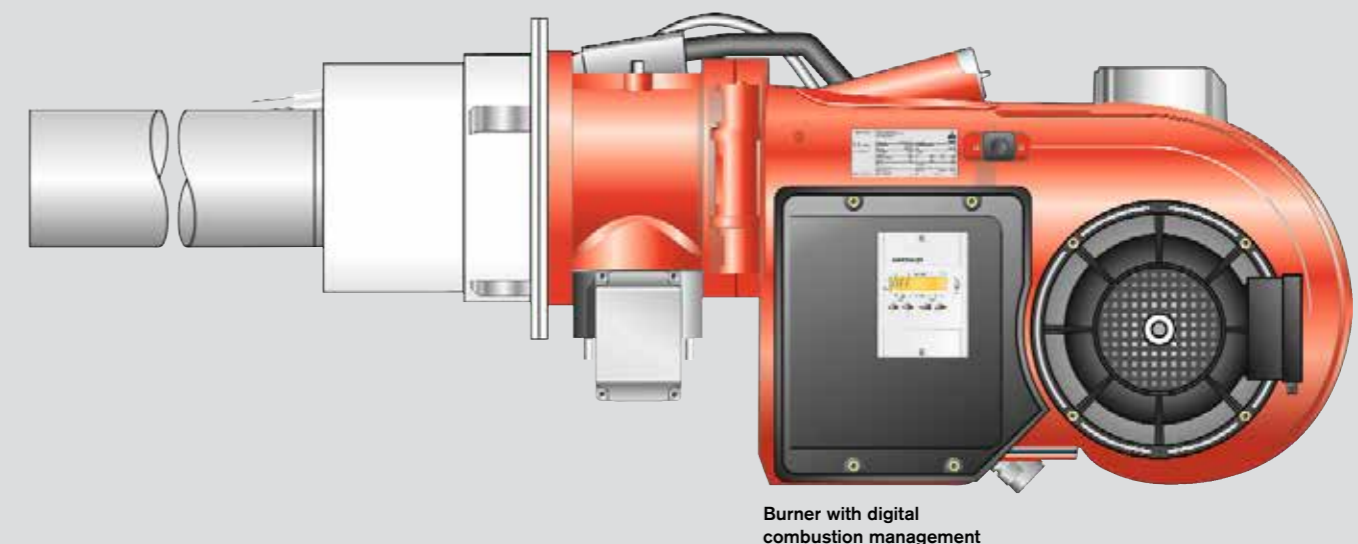


| Features – digital combustion management   | W-FM 50         | W-FM 100 | W-FM 200 |
|--|-----------------|----------|----------|
| Single-fuel operation  | ●               | ●        | ●        |
| Dual-fuel operation  | –               | ●        | ●        |
| Intermittent firing  | ●               | ●        | ●        |
| Continuous firing >24 h  | ●               | ●        | ●        |
| Variable speed drive   | ●               | –        | ●        |
| O <sub>2</sub> trim  | –               | –        | ●        |
| CO monitoring  | –               | –        | ○        |
| Combined O <sub>2</sub> /CO control  | –               | –        | ○        |
| ION/LFW flame sensor for continuous firing   | ●               | ●        | ●        |
| Maximum number of actuators  | 2               | 4        | 6        |
| Gas valve proving  | ●               | ●        | ●        |
| Integrated PID controller with automatic adaption. Pt/Ni temperature sensor, 0/2–10 V, and 0/4–20 mA inputs for temperature/pressure | –               | ○        | ●        |
| 0/2–10 V and 0/4–20 mA setpoint input for temperature/pressure   | –               | ○        | ●        |
| Configurable 0/4–20 mA analogue output   | –               | ○        | ●        |
| Language-neutral ABE control unit  | ●               | –        | –        |
| ABE control unit with 20 available languages (any one ABE limited to 6)  | –               | ●        | ●        |
| Dual-language/script ABE control unit (Chinese/English)  | –               | ○        | ○        |
| Removable ABE control unit (max. length of connecting line)  | 20 m            | 100 m    | 100 m    |
| Fuel consumption meter (switchable)  | ● <sup>1)</sup> | –        | ●        |
| Combustion efficiency display  | –               | –        | ●        |
| eBUS/Modbus RTU interface  | ●               | ●        | ●        |
| PC-supported commissioning   | ●               | ●        | ●        |

● Standard ○ Optional <sup>1)</sup> Not in conjunction with VSD

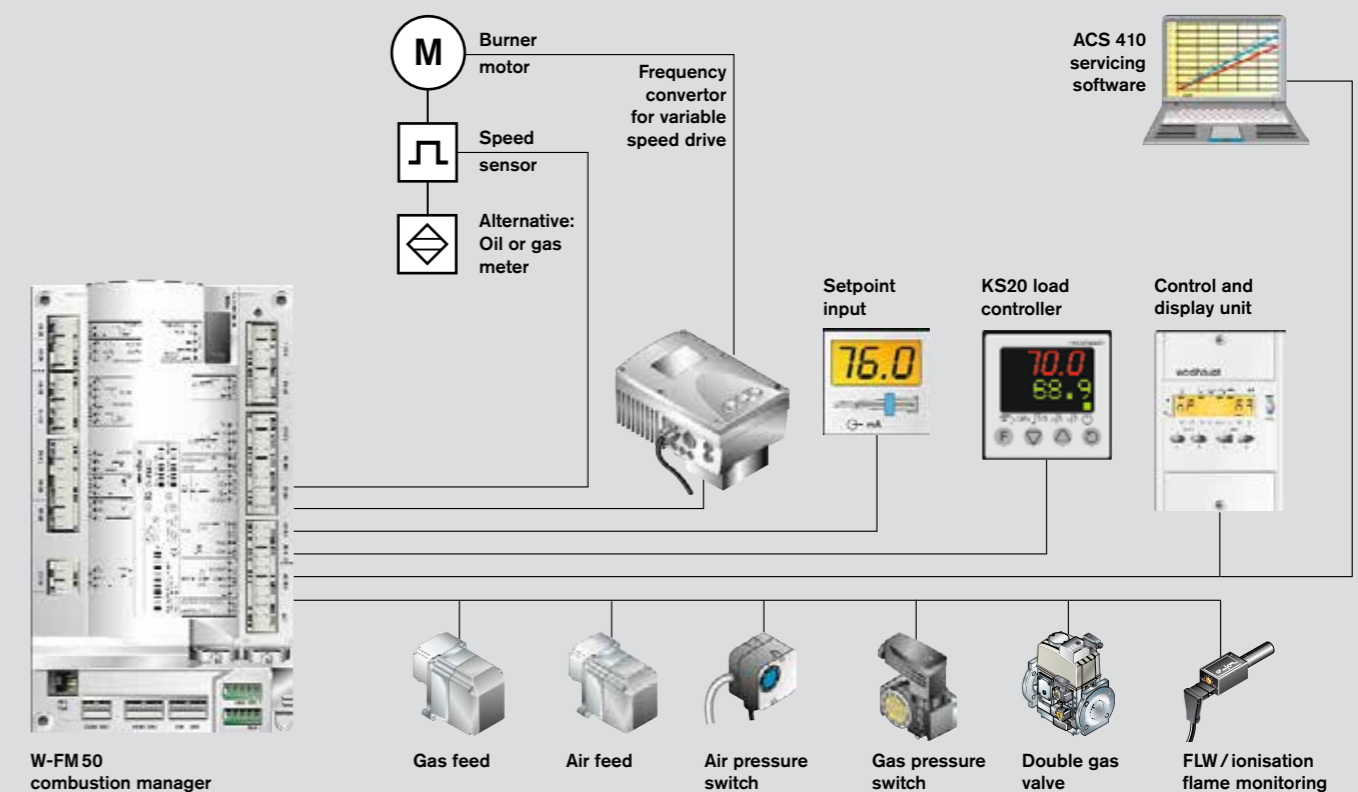

# Flexible communications: Compatible with building management systems

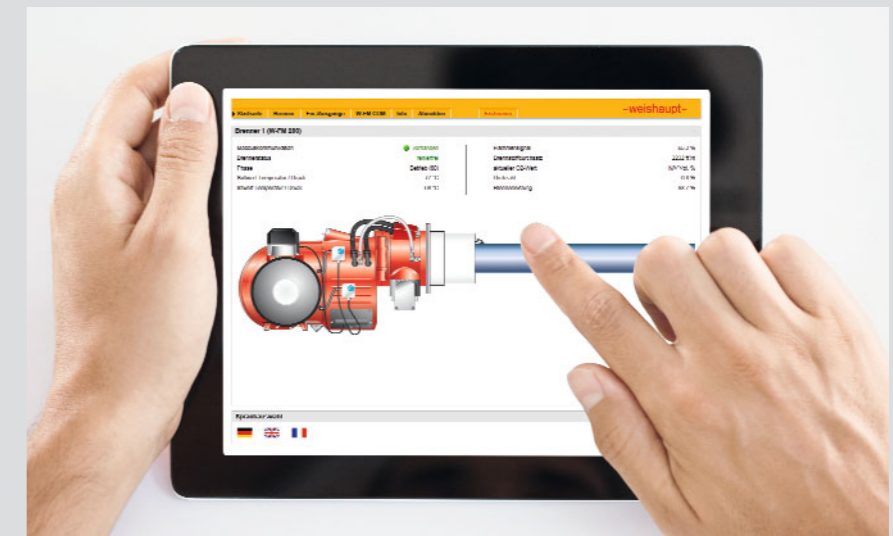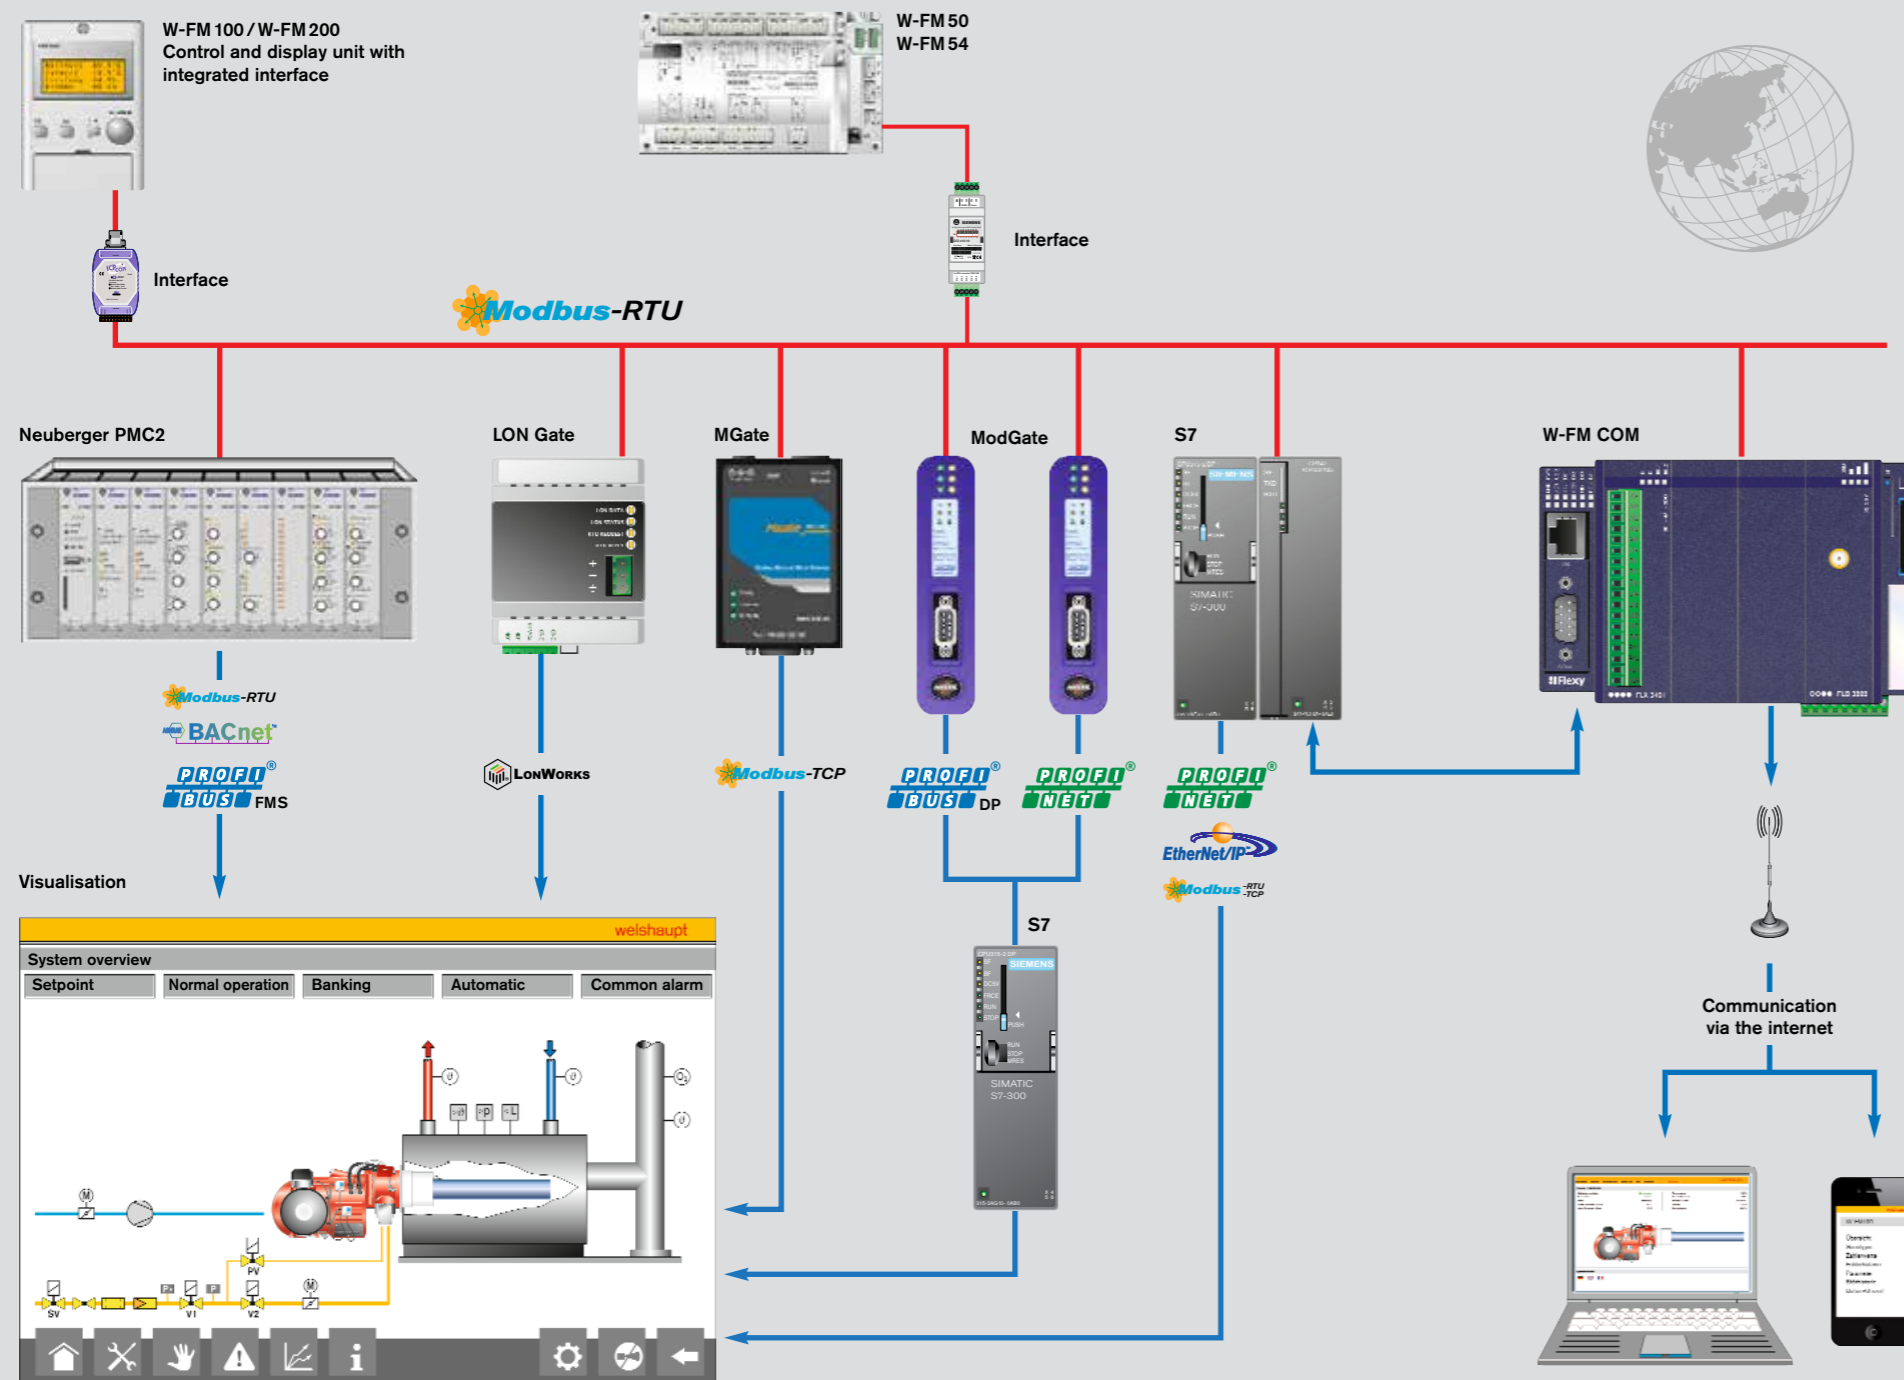

Remote monitoring made easy via tablet or laptop

**The digital combustion manager is the basis of communications with other superordinate systems. This is generally achieved using the eBus or Modbus protocols.**

All the usual burner and boiler functions can be monitored and controlled through a direct connection with a building management system.

A graphical HMI is available as an option to provide a user-friendly overview of the boiler. The touchscreen display allows numerous functions to be adjusted and monitored, such as system parameters and setpoints of individual and multi-boiler plant and ancillary equipment.

The controls specialists, Neuberger, who are a part of the Weishaupt Group, are able to design and implement complex control solutions.


Further optional components enable connections to be made to systems using commonplace industrial standards, such as Profibus-DP, LON-Bus, and Modbus RTU, and network protocols such as Profinet I/O, Modbus TCP, BacNet, etc.

A recent addition to Weishaupt's portfolio is the W-FM COM communications module. It transmits data securely over the internet so that it can be called up and displayed in a browser window on a computer, tablet, or smartphone, facilitating accurate service planning for example. Even away from the internet you can be kept up to date with the operation of the burner: In the event of a safety shutdown or other predefined trigger, an SMS text message is sent automatically.



# Burner selection / gas valve train sizing

## WM-G10, version ZM-PLN

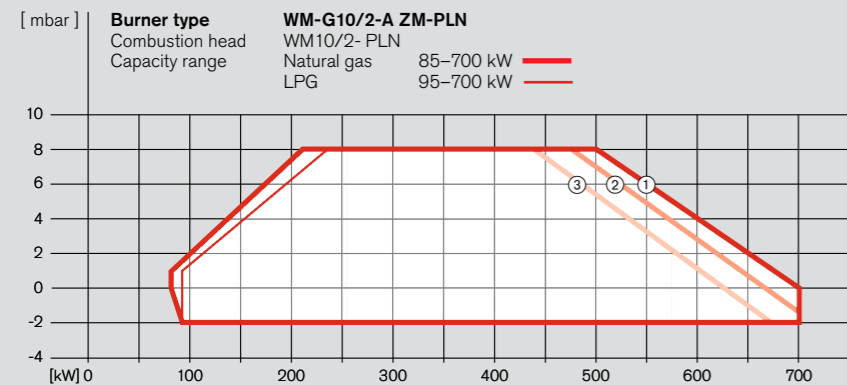

**Determining load point dependent on excess air**  
(See example on page 20)

|   | NO <sub>x</sub> [mg/kWh] |     | Setting* λ     |      | P <sub>F</sub> factor <sup>1)</sup> |
|---|--------------------------|-----|----------------|------|-------------------------------------|
|   | N. Gas                   | LPG | O <sub>2</sub> |      |                                     |
| ① | 80                       | 150 | 5 %            | 1.28 | 1.24                                |
| ② | 30                       | 60  | 7 %            | 1.46 | 1.61                                |
| ③ | 20                       | -   | 8 %            | 1.56 | 1.84                                |


<sup>1)</sup> The correction factor is based on the combustion chamber resistance (P<sub>F</sub>) at 3 % O<sub>2</sub>.  
\* Site-specific setting conditions may vary.

**NO<sub>x</sub> reference conditions:**


Air temperature = 20 °C  
Air humidity = 10 g/kg  
LHV, natural gas E = 10.35 kWh/m<sup>3</sup>  
LHV, propane = 25.89 kWh/m<sup>3</sup>  
LHV referenced to 0 °C and 1013 mbar atmospheric

- Measurement at every load point
- No averaging
- No measurement uncertainty/tolerance
- Three-pass combustion chamber

**Low-pressure supply**




**High-pressure supply**



The high-pressure regulator should have a spring selected that enables the available outlet pressure (P<sub>0</sub> = 140 / 100 / 50 mbar) to be adjusted.


**Setting pressure at the FRS regulator**

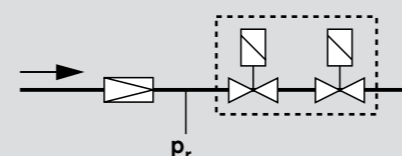

**WM-G10/2-A, version ZM-PLN**

| Burner rating [kW]  | Low-pressure supply P <sub>i</sub> |    |        |    |    | High-pressure supply P <sub>0</sub> = 140 / 100 / 50 mbar |    |        | P <sub>r</sub>               |    |        |    |    |   |
|---|------------------------------------|----|--------|----|----|---|----|--------|------------------------------|----|--------|----|----|---|
|   | Nominal valve train diameter       |    |        |    |    | Nominal valve train diameter                              |    |        | Nominal valve train diameter |    |        |    |    |   |
|   | 3/4"                               | 1" | 1 1/2" | 2" | 65 | 3/4"  | 1" | 1 1/2" | 3/4"                         | 1" | 1 1/2" | 2" | 65 |   |
| <b>Natural gas E</b> LHV = 10.35 kWh/m <sup>3</sup> ; d = 0.606 |                                    |    |        |    |    |   |    |        |                              |    |        |    |    |   |
| 300   | 33                                 | -  | -      | -  | -  | 36  | 25 | 21     | 11                           | -  | -      | -  | -  | - |
| 350   | 42                                 | 21 | -      | -  | -  | 43  | 27 | 22     | 14                           | 8  | -      | -  | -  | - |
| 400   | 52                                 | 25 | -      | -  | -  | 50  | 30 | 24     | 18                           | 9  | -      | -  | -  | - |
| 450   | 64                                 | 30 | 16     | -  | -  | 59  | 33 | 25     | 22                           | 10 | 8      | -  | -  | - |
| 500   | 78                                 | 36 | 19     | -  | -  | 69  | 37 | 28     | 26                           | 12 | 10     | -  | -  | - |
| 550   | 93                                 | 43 | 22     | 15 | -  | 81  | 42 | 31     | 32                           | 15 | 13     | 9  | -  | - |
| 600   | 110                                | 50 | 26     | 17 | 15 | 94  | 47 | 34     | 39                           | 18 | 15     | 10 | 10 | - |
| 700   | 149                                | 66 | 33     | 22 | 19 | 122   | 59 | 41     | 53                           | 25 | 21     | 14 | 13 | - |
| <b>Natural gas LL</b> LHV = 8.83 kWh/m <sup>3</sup> ; d = 0.641 |                                    |    |        |    |    |   |    |        |                              |    |        |    |    |   |
| 300   | 44                                 | 22 | -      | -  | -  | 44  | 27 | 22     | 15                           | 7  | -      | -  | -  | - |
| 350   | 57                                 | 27 | 15     | -  | -  | 54  | 31 | 24     | 19                           | 9  | 8      | -  | -  | - |
| 400   | 72                                 | 33 | 18     | -  | -  | 65  | 35 | 26     | 24                           | 11 | 9      | -  | -  | - |
| 450   | 89                                 | 40 | 20     | -  | -  | 78  | 40 | 29     | 30                           | 13 | 11     | -  | -  | - |
| 500   | 109                                | 48 | 24     | -  | -  | 92  | 45 | 32     | 37                           | 16 | 13     | -  | -  | - |
| 550   | 131                                | 57 | 28     | 17 | -  | 109   | 52 | 36     | 45                           | 20 | 16     | 10 | -  | - |
| 600   | 155                                | 68 | 32     | 20 | 17 | 127   | 59 | 40     | 53                           | 24 | 19     | 12 | 11 | - |
| 700   | 210                                | 90 | 42     | 25 | 21 | -   | 75 | 49     | 72                           | 32 | 26     | 17 | 15 | - |
| <b>LPG*</b> LHV = 25.89 kWh/m <sup>3</sup> ; d = 1.555          |                                    |    |        |    |    |   |    |        |                              |    |        |    |    |   |
| 300   | 18                                 | -  | -      | -  | -  | 26  | 21 | -      | 7                            | -  | -      | -  | -  | - |
| 350   | 22                                 | -  | -      | -  | -  | 28  | 22 | -      | 8                            | -  | -      | -  | -  | - |
| 400   | 26                                 | -  | -      | -  | -  | 31  | 23 | -      | 9                            | -  | -      | -  | -  | - |
| 450   | 31                                 | -  | -      | -  | -  | 35  | 24 | -      | 11                           | -  | -      | -  | -  | - |
| 500   | 37                                 | 20 | -      | -  | -  | 39  | 26 | -      | 13                           | 7  | -      | -  | -  | - |
| 550   | 44                                 | 23 | -      | -  | -  | 44  | 28 | -      | 16                           | 9  | -      | -  | -  | - |
| 600   | 51                                 | 26 | -      | -  | -  | 50  | 31 | -      | 19                           | 11 | -      | -  | -  | - |
| 700   | 68                                 | 34 | -      | -  | -  | 63  | 37 | -      | 26                           | 14 | -      | -  | -  | - |

The LHV is referenced to 0 °C and 1013 mbar atmospheric pressure. All pressures are in mbar.  
\* The LPG charts are based on propane, but may also be used for butane.

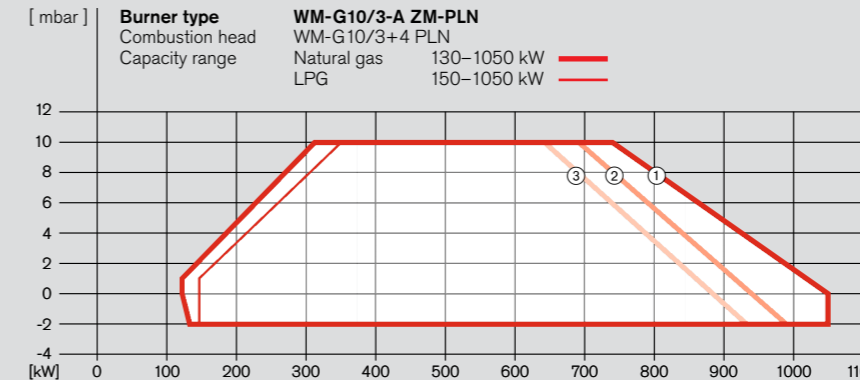

**WM-G10/3-A, version ZM-PLN**

| Burner rating [kW]  | Low-pressure supply P <sub>i</sub> |     |        |    |    |    |      | High-pressure supply P <sub>0</sub> = 140 / 100 / 50 mbar |        |      | P <sub>r</sub>               |        |    |    |    |  |  |
|---|------------------------------------|-----|--------|----|----|----|------|---|--------|------|------------------------------|--------|----|----|----|--|--|
|   | Nominal valve train diameter       |     |        |    |    |    |      | Nominal valve train diameter                              |        |      | Nominal valve train diameter |        |    |    |    |  |  |
|   | 3/4"                               | 1"  | 1 1/2" | 2" | 65 | 80 | 3/4" | 1"  | 1 1/2" | 3/4" | 1"                           | 1 1/2" | 2" | 65 | 80 |  |  |
| <b>Natural gas E</b> LHV = 10.35 kWh/m <sup>3</sup> ; d = 0.606 |                                    |     |        |    |    |    |      |   |        |      |                              |        |    |    |    |  |  |
| 500   | 76                                 | 34  | 17     | -  | -  | -  | 68   | 35  | 26     | 25   | 11                           | 9      | -  | -  | -  |  |  |
| 550   | 91                                 | 40  | 20     | -  | -  | -  | 79   | 40  | 28     | 30   | 13                           | 10     | -  | -  | -  |  |  |
| 600   | 107                                | 47  | 23     | -  | -  | -  | 91   | 44  | 31     | 35   | 15                           | 12     | -  | -  | -  |  |  |
| 650   | 125                                | 54  | 26     | 16 | -  | -  | 104  | 49  | 33     | 42   | 18                           | 14     | 8  | -  | -  |  |  |
| 700   | 145                                | 62  | 29     | 18 | -  | -  | 119  | 55  | 37     | 49   | 21                           | 17     | 10 | -  | -  |  |  |
| 800   | 188                                | 81  | 38     | 22 | 18 | 17 | -    | 68  | 44     | 64   | 28                           | 22     | 14 | 12 | 12 |  |  |
| 900   | 237                                | 101 | 46     | 27 | 22 | 20 | -    | 83  | 52     | 81   | 35                           | 28     | 18 | 16 | 15 |  |  |
| 1000  | 291                                | 123 | 56     | 32 | 26 | 24 | -    | 98  | 61     | 100  | 43                           | 34     | 22 | 19 | 18 |  |  |
| 1050  | -                                  | 135 | 61     | 35 | 28 | 26 | -    | 107   | 65     | -    | 47                           | 38     | 24 | 21 | 20 |  |  |
| <b>Natural gas LL</b> LHV = 8.83 kWh/m <sup>3</sup> ; d = 0.641 |                                    |     |        |    |    |    |      |   |        |      |                              |        |    |    |    |  |  |
| 500   | 107                                | 46  | 21     | -  | -  | -  | 90   | 43  | 29     | 34   | 14                           | 11     | -  | -  | -  |  |  |
| 550   | 128                                | 55  | 25     | -  | -  | -  | 106  | 49  | 33     | 42   | 17                           | 13     | -  | -  | -  |  |  |
| 600   | 152                                | 64  | 29     | 17 | -  | -  | 123  | 56  | 36     | 50   | 20                           | 16     | 9  | -  | -  |  |  |
| 650   | 178                                | 75  | 33     | 19 | -  | -  | -    | 63  | 40     | 59   | 24                           | 18     | 11 | -  | -  |  |  |
| 700   | 206                                | 86  | 39     | 22 | 17 | 16 | -    | 72  | 45     | 68   | 28                           | 22     | 13 | 11 | 10 |  |  |
| 800   | 268                                | 112 | 50     | 27 | 22 | 20 | -    | 90  | 55     | 90   | 37                           | 29     | 17 | 15 | 14 |  |  |
| 900   | -                                  | 141 | 61     | 33 | 26 | 24 | -    | 110   | 65     | -    | 47                           | 37     | 22 | 19 | 18 |  |  |
| 1000  | -                                  | 172 | 74     | 40 | 31 | 28 | -    | 131   | 77     | -    | 58                           | 45     | 26 | 23 | 21 |  |  |
| 1050  | -                                  | 189 | 81     | 43 | 33 | 30 | -    | -   | 83     | -    | 63                           | 50     | 29 | 25 | 23 |  |  |
| <b>LPG*</b> LHV = 25.89 kWh/m <sup>3</sup> ; d = 1.555          |                                    |     |        |    |    |    |      |   |        |      |                              |        |    |    |    |  |  |
| 500   | 36                                 | -   | -      | -  | -  | -  | 39   | 25  | 22     | 13   | -                            | -      | -  | -  | -  |  |  |
| 550   | 42                                 | -   | -      | -  | -  | -  | 43   | 27  | 22     | 14   | -                            | -      | -  | -  | -  |  |  |
| 600   | 48                                 | -   | -      | -  | -  | -  | 48   | 29  | 23     | 16   | -                            | -      | -  | -  | -  |  |  |
| 650   | 55                                 | 26  | -      | -  | -  | -  | 53   | 30  | 24     | 19   | 9                            | -      | -  | -  | -  |  |  |
| 700   | 64                                 | 30  | 17     | -  | -  | -  | 59   | 33  | 26     | 22   | 10                           | 9      | -  | -  | -  |  |  |
| 800   | 83                                 | 39  | 21     | -  | -  | -  | 73   | 39  | 30     | 29   | 14                           | 12     | -  | -  | -  |  |  |
| 900   | 104                                | 48  | 25     | -  | -  | -  | 89   | 46  | 34     | 37   | 18                           | 15     | -  | -  | -  |  |  |
| 1000  | 127                                | 58  | 30     | -  | -  | -  | 107  | 54  | 38     | 46   | 22                           | 19     | -  | -  | -  |  |  |
| 1050  | 139                                | 63  | 33     | -  | -  | -  | 116  | 57  | 40     | 50   | 25                           | 21     | -  | -  | -  |  |  |

The LHV is referenced to 0 °C and 1013 mbar atmospheric pressure. All pressures are in mbar.  
\* The LPG charts are based on propane, but may also be used for butane.

Capacity graphs for gas burners certified in accordance with EN 676.

Stated ratings are based on an air temperature of 20 °C and an installation at sea level. For installations at higher altitudes, a reduction in capacity of 1 % per 100 m above sea level should be taken into account.

Stated flow pressures are based on a combustion chamber resistance of 0 mbar. The combustion chamber pressure of the heat generator must be added to the figure determined from the above chart when sizing the gas valve train.

For low-pressure supplies, EN 88-compliant regulators with safety diaphragms are used.

For high-pressure supplies, an EN 334-compliant high-pressure regulator should be selected from the following technical booklets:  
• Regulators up to 4 bar, Print No. 83001202  
• Regulators with safety devices, Print No. 83197902

Refer to the burner's rating plate for the maximum connection pressure.

**Maximum Operating Pressure (MOP)**

The supplier must safeguard the gas flow pressure such that it cannot exceed the MOP of the burner's gas valve train.

**Rating of low-pressure gas valve trains (LP)**

Normally, low-pressure valve trains are used for gas flow pressures up to a maximum of 300 mbar. This allows for pressure losses between the transfer station and the valve train. Furthermore, it is assumed that the transfer station utilises components (SSV, SRV, regulator) that are not of the highest class of accuracy. In individual cases, following consideration and approval by Weishaupt's headquarters, a gas flow pressure of up to 360 mbar can be approved if the appropriate conditions exist.


**Rating of high-pressure gas valve trains (LP)**

Normally, high-pressure valve trains are used for gas flow pressures above 300 mbar.

**Double gas valve assemblies**

| Screwed |            |
|---------|------------|
| R 3/4   | W-MF507    |
| R 1     | W-MF512    |
| R 1 1/2 | W-MF512    |
| R 2     | DMV525/12  |
| Flanged |            |
| DN 65   | DMV5065/12 |
| DN 80   | DMV5080/12 |
| DN 100  | DMV5100/12 |

# Burner selection / gas valve train sizing WM-G10, version ZM-PLN

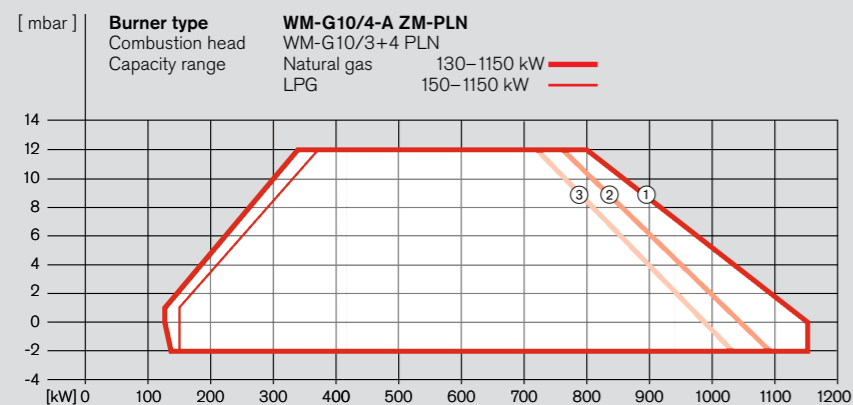

**Determining load point dependent on excess air**  
(See example on page 20)

|   | NO <sub>x</sub> [mg/kWh] |     | Setting* O <sub>2</sub> |      | P <sub>F</sub> factor <sup>1)</sup> |
|---|--------------------------|-----|-------------------------|------|-------------------------------------|
|   | N. Gas                   | LPG | O <sub>2</sub>          | λ    |                                     |
| ① | 80                       | 150 | 5 %                     | 1.28 | 1.24                                |
| ② | 30                       | 60  | 7 %                     | 1.46 | 1.61                                |
| ③ | 20                       | -   | 8 %                     | 1.56 | 1.84                                |


<sup>1)</sup> The correction factor is based on the combustion chamber resistance (P<sub>F</sub>) at 3 % O<sub>2</sub>.  
\* Site-specific setting conditions may vary.

**NO<sub>x</sub> reference conditions:**


Air temperature = 20 °C  
Air humidity = 10 g/kg  
LHV, natural gas E = 10.35 kWh/m<sup>3</sup>  
LHV, propane = 25.89 kWh/m<sup>3</sup>  
LHV referenced to 0 °C and 1013 mbar atmospheric

- Measurement at every load point
- No averaging
- No measurement uncertainty/tolerance
- Three-pass combustion chamber

**Low-pressure supply**

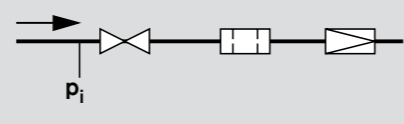


**High-pressure supply**



The high-pressure regulator should have a spring selected that enables the available outlet pressure (P<sub>o</sub> = 140 / 100 / 50 mbar) to be adjusted.

**Setting pressure at the FRS regulator**

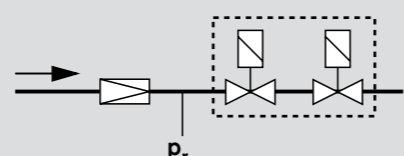


**WM-G10/4-A, version ZM-PLN**

| Burner rating [kW]  | Low-pressure supply P <sub>i</sub> |        |    |    |        | High-pressure supply P <sub>o</sub> = 140 / 100 / 50 mbar |        |    |    |        | P <sub>r</sub>               |        |    |    |        |  |
|---|------------------------------------|--------|----|----|--------|---|--------|----|----|--------|------------------------------|--------|----|----|--------|--|
|   | Nominal valve train diameter       |        |    |    |        | Nominal valve train diameter                              |        |    |    |        | Nominal valve train diameter |        |    |    |        |  |
|   | 1"                                 | 1 1/2" | 2" | 65 | 80 100 | 1"  | 1 1/2" | 2" | 65 | 80 100 | 1"                           | 1 1/2" | 2" | 65 | 80 100 |  |
| <b>Natural gas E</b> LHV = 10.35 kWh/m <sup>3</sup> ; d = 0.606 |                                    |        |    |    |        |   |        |    |    |        |                              |        |    |    |        |  |
| 500   | 34                                 | 17     | -  | -  | -      | 35  | 26     | -  | -  | -      | 11                           | 9      | -  | -  | -      |  |
| 550   | 40                                 | 20     | -  | -  | -      | 40  | 28     | -  | -  | -      | 13                           | 10     | -  | -  | -      |  |
| 600   | 47                                 | 23     | -  | -  | -      | 44  | 31     | -  | -  | -      | 15                           | 12     | -  | -  | -      |  |
| 650   | 54                                 | 26     | 16 | -  | -      | 49  | 34     | -  | -  | -      | 18                           | 14     | 9  | -  | -      |  |
| 700   | 62                                 | 29     | 18 | -  | -      | 55  | 37     | -  | -  | -      | 21                           | 17     | 10 | -  | -      |  |
| 800   | 81                                 | 38     | 23 | 19 | 17     | 68  | 44     | -  | -  | -      | 28                           | 22     | 14 | 12 | 12     |  |
| 900   | 101                                | 47     | 28 | 23 | 21     | 83  | 53     | -  | -  | -      | 36                           | 29     | 18 | 16 | 15     |  |
| 1000  | 124                                | 57     | 33 | 27 | 24     | 99  | 61     | -  | -  | -      | 44                           | 35     | 22 | 19 | 18     |  |
| 1100  | 148                                | 67     | 38 | 31 | 28     | 116   | 71     | -  | -  | -      | 52                           | 42     | 26 | 23 | 21     |  |
| <b>Natural gas LL</b> LHV = 8.83 kWh/m <sup>3</sup> ; d = 0.641 |                                    |        |    |    |        |   |        |    |    |        |                              |        |    |    |        |  |
| 500   | 46                                 | 21     | -  | -  | -      | 43  | 29     | -  | -  | -      | 14                           | 11     | -  | -  | -      |  |
| 550   | 54                                 | 25     | -  | -  | -      | 49  | 33     | -  | -  | -      | 17                           | 13     | -  | -  | -      |  |
| 600   | 64                                 | 29     | 16 | -  | -      | 56  | 36     | -  | -  | -      | 20                           | 15     | 9  | -  | -      |  |
| 650   | 74                                 | 33     | 18 | -  | -      | 63  | 40     | -  | -  | -      | 23                           | 18     | 10 | -  | -      |  |
| 700   | 85                                 | 37     | 20 | 16 | -      | 70  | 43     | -  | -  | -      | 27                           | 21     | 11 | 9  | -      |  |
| 800   | 111                                | 48     | 26 | 21 | 18     | 88  | 53     | -  | -  | -      | 36                           | 28     | 16 | 14 | 13     |  |
| 900   | 140                                | 61     | 33 | 25 | 23     | 109   | 64     | -  | -  | -      | 46                           | 36     | 21 | 18 | 17     |  |
| 1000  | 172                                | 74     | 39 | 30 | 27     | 131   | 76     | -  | -  | -      | 57                           | 45     | 26 | 22 | 21     |  |
| 1100  | 206                                | 88     | 46 | 36 | 31     | 159   | 89     | -  | -  | -      | 69                           | 54     | 31 | 26 | 24     |  |
| <b>LPG*</b> LHV = 25.89 kWh/m <sup>3</sup> ; d = 1.555          |                                    |        |    |    |        |   |        |    |    |        |                              |        |    |    |        |  |
| 500   | 19                                 | -      | -  | -  | -      | 25  | 22     | -  | -  | -      | 7                            | -      | -  | -  | -      |  |
| 550   | 21                                 | -      | -  | -  | -      | 27  | 22     | -  | -  | -      | 7                            | -      | -  | -  | -      |  |
| 600   | 24                                 | -      | -  | -  | -      | 29  | 23     | -  | -  | -      | 8                            | -      | -  | -  | -      |  |
| 650   | 27                                 | 15     | -  | -  | -      | 31  | 24     | -  | -  | -      | 9                            | 8      | -  | -  | -      |  |
| 700   | 29                                 | 16     | -  | -  | -      | 32  | 24     | -  | -  | -      | 9                            | 8      | -  | -  | -      |  |
| 800   | 37                                 | 20     | -  | -  | -      | 38  | 28     | -  | -  | -      | 13                           | 11     | -  | -  | -      |  |
| 900   | 47                                 | 24     | -  | -  | -      | 45  | 33     | -  | -  | -      | 17                           | 14     | -  | -  | -      |  |
| 1000  | 57                                 | 29     | -  | -  | -      | 53  | 37     | -  | -  | -      | 21                           | 18     | -  | -  | -      |  |
| 1100  | 68                                 | 34     | -  | -  | -      | 60  | 42     | -  | -  | -      | 26                           | 21     | -  | -  | -      |  |

The LHV is referenced to 0 °C and 1013 mbar atmospheric pressure. All pressures are in mbar.  
\* The LPG charts are based on propane, but may also be used for butane.

# Burner selection / gas valve train sizing WM-G20, version ZM-PLN

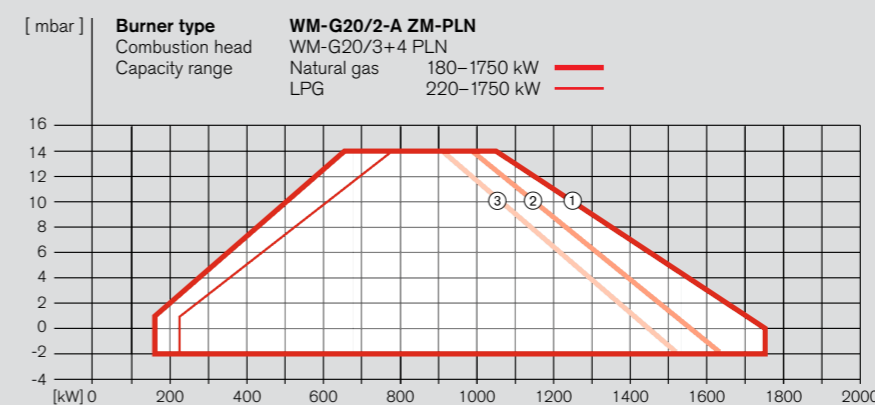

**WM-G20/2-A, version ZM-PLN**

| Burner rating [kW]  | Low-pressure supply P <sub>i</sub> |        |    |    |        | High-pressure supply P <sub>o</sub> = 140 / 100 / 50 mbar |        |     |    |        | P <sub>r</sub>               |        |    |    |        |  |
|---|------------------------------------|--------|----|----|--------|---|--------|-----|----|--------|------------------------------|--------|----|----|--------|--|
|   | Nominal valve train diameter       |        |    |    |        | Nominal valve train diameter                              |        |     |    |        | Nominal valve train diameter |        |    |    |        |  |
|   | 1"                                 | 1 1/2" | 2" | 65 | 80 100 | 1"  | 1 1/2" | 2"  | 65 | 80 100 | 1"                           | 1 1/2" | 2" | 65 | 80 100 |  |
| <b>Natural gas E</b> LHV = 10.35 kWh/m <sup>3</sup> ; d = 0.606 |                                    |        |    |    |        |   |        |     |    |        |                              |        |    |    |        |  |
| 800   | 71                                 | 28     | -  | -  | -      | 59  | 35     | 18  | -  | -      | 18                           | 12     | -  | -  | -      |  |
| 900   | 89                                 | 35     | -  | -  | -      | 71  | 40     | 19  | -  | -      | 23                           | 16     | -  | -  | -      |  |
| 1000  | 109                                | 42     | -  | -  | -      | 84  | 47     | 21  | -  | -      | 29                           | 20     | -  | -  | -      |  |
| 1100  | 131                                | 50     | 21 | -  | -      | 99  | 54     | 22  | -  | -      | 35                           | 25     | 9  | -  | -      |  |
| 1200  | 156                                | 59     | 25 | -  | -      | 115   | 61     | 24  | -  | -      | 42                           | 30     | 11 | -  | -      |  |
| 1300  | 182                                | 68     | 28 | 18 | -      | 133   | 69     | 25  | -  | -      | 50                           | 35     | 13 | 9  | -      |  |
| 1400  | 210                                | 79     | 32 | 20 | 15     | -   | 78     | 27  | -  | -      | 58                           | 41     | 15 | 10 | 9      |  |
| 1500  | 241                                | 89     | 36 | 22 | 17     | -   | 88     | 29  | -  | -      | 66                           | 47     | 17 | 12 | 10     |  |
| 1600  | 273                                | 101    | 40 | 24 | 18     | 15  | -      | 97  | 31 | -      | 75                           | 53     | 20 | 13 | 11     |  |
| 1750  | -                                  | 119    | 46 | 28 | 21     | 17  | -      | 113 | 33 | -      | -                            | 63     | 23 | 15 | 13     |  |
| <b>Natural gas LL</b> LHV = 8.83 kWh/m <sup>3</sup> ; d = 0.641 |                                    |        |    |    |        |   |        |     |    |        |                              |        |    |    |        |  |
| 800   | 101                                | 39     | -  | -  | -      | 79  | 44     | 20  | -  | -      | 27                           | 19     | -  | -  | -      |  |
| 900   | 128                                | 49     | 21 | -  | -      | 97  | 52     | 22  | -  | -      | 34                           | 24     | 9  | -  | -      |  |
| 1000  | 157                                | 59     | 25 | -  | -      | 116   | 62     | 24  | -  | -      | 43                           | 30     | 11 | -  | -      |  |
| 1100  | 189                                | 71     | 29 | 18 | -      | 138   | 72     | 26  | -  | -      | 52                           | 36     | 14 | 9  | -      |  |
| 1200  | 224                                | 84     | 34 | 21 | 16     | -   | 83     | 28  | -  | -      | 61                           | 43     | 16 | 11 | 9      |  |
| 1300  | 262                                | 97     | 39 | 24 | 18     | 15  | -      | 94  | 30 | -      | 72                           | 51     | 19 | 13 | 11     |  |
| 1400  | -                                  | 112    | 44 | 27 | 20     | 17  | -      | 107 | 33 | -      | -                            | 59     | 22 | 14 | 12     |  |
| 1500  | -                                  | 128    | 50 | 30 | 22     | 18  | -      | 120 | 35 | -      | -                            | 67     | 25 | 16 | 14     |  |
| 1600  | -                                  | 144    | 56 | 33 | 24     | 20  | -      | 135 | 38 | -      | -                            | 76     | 28 | 18 | 15     |  |
| 1750  | -                                  | 170    | 64 | 38 | 28     | 22  | -      | 161 | 42 | -      | -                            | 91     | 33 | 21 | 18     |  |
| <b>LPG*</b> LHV = 25.89 kWh/m <sup>3</sup> ; d = 1.555          |                                    |        |    |    |        |   |        |     |    |        |                              |        |    |    |        |  |
| 800   | 33                                 | -      | -  | -  | -      | 33  | 24     | 17  | -  | -      | 8                            | -      | -  | -  | -      |  |
| 900   | 40                                 | -      | -  | -  | -      | 39  | 26     | 18  | -  | -      | 11                           | -      | -  | -  | -      |  |
| 1000  | 49                                 | 22     | -  | -  | -      | 45  | 30     | 19  | -  | -      | 14                           | 10     | -  | -  | -      |  |
| 1100  | 59                                 | 26     | -  | -  | -      | 52  | 33     | 20  | -  | -      | 17                           | 13     | -  | -  | -      |  |
| 1200  | 69                                 | 30     | -  | -  | -      | 59  | 37     | 21  | -  | -      | 20                           | 15     | -  | -  | -      |  |
| 1300  | 81                                 | 34     | 18 | -  | -      | 66  | 40     | 22  | -  | -      | 24                           | 18     | 9  | -  | -      |  |
| 1400  | 93                                 | 39     | 20 | -  | -      | 75  | 44     | 23  | -  | -      | 27                           | 21     | 10 | -  | -      |  |
| 1500  | 106                                | 44     | 22 | -  | -      | 83  | 49     | 25  | -  | -      | 31                           | 23     | 12 | -  | -      |  |
| 1600  | 120                                | 49     | 24 | -  | -      | 93  | 53     | 26  | -  | -      | 36                           | 27     | 13 | -  | -      |  |
| 1750  | 142                                | 57     | 27 | -  | -      | 108   | 61     | 28  | -  | -      | 42                           | 31     | 15 | -  | -      |  |

The LHV is referenced to 0 °C and 1013 mbar atmospheric pressure. All pressures are in mbar.  
\* The LPG charts are based on propane, but may also be used for butane.

Capacity graphs for gas burners certified in accordance with EN 676.

Stated ratings are based on an air temperature of 20 °C and an installation at sea level. For installations at higher altitudes, a reduction in capacity of 1 % per 100 m above sea level should be taken into account.

Stated flow pressures are based on a combustion chamber resistance of 0 mbar. The combustion chamber pressure of the heat generator must be added to the figure determined from the above chart when sizing the gas valve train.

For low-pressure supplies, EN 88-compliant regulators with safety diaphragms are used.

For high-pressure supplies, an EN 334-compliant high-pressure regulator should be selected from the following technical booklets:  
• Regulators up to 4 bar, Print No. 83001202  
• Regulators with safety devices, Print No. 83197902

Refer to the burner's rating plate for the maximum connection pressure.

**Maximum Operating Pressure (MOP)**

The supplier must safeguard the gas flow pressure such that it cannot exceed the MOP of the burner's gas valve train.

**Rating of low-pressure gas valve trains (LP)**

Normally, low-pressure valve trains are used for gas flow pressures up to a maximum of 300 mbar. This allows for pressure losses between the transfer station and the valve train. Furthermore, it is assumed that the transfer station utilises components (SSV, SRV, regulator) that are not of the highest class of accuracy. In individual cases, following consideration and approval by Weishaupt's headquarters, a gas flow pressure of up to 360 mbar can be approved if the appropriate conditions exist.


**Rating of high-pressure gas valve trains (LP)**

Normally, high-pressure valve trains are used for gas flow pressures above 300 mbar.

**Double gas valve assemblies**

| Screwed |            |
|---------|------------|
| R 3/4   | W-MF507    |
| R 1     | W-MF512    |
| R 1 1/2 | W-MF512    |
| R 2     | DMV525/12  |
| Flanged |            |
| DN 65   | DMV5065/12 |
| DN 80   | DMV5080/12 |
| DN 100  | DMV5100/12 |

# Burner selection / gas valve train sizing WM-G20, version ZM-PLN

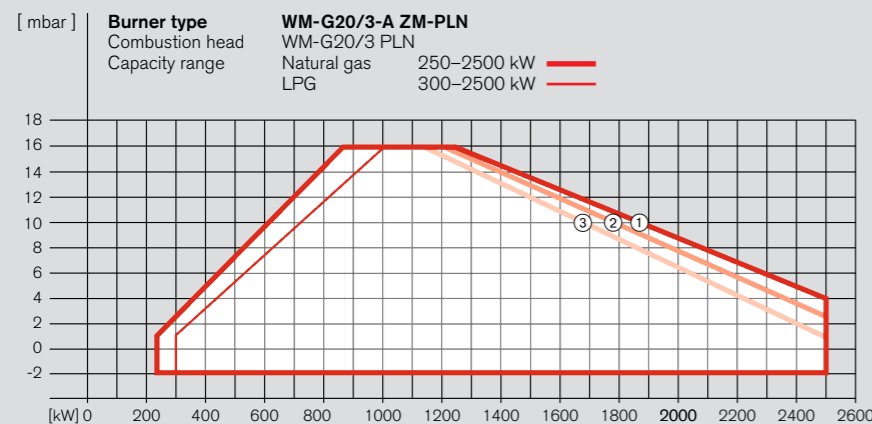

**Determining load point dependent on excess air**  
(See example on page 20)

|   | NO <sub>x</sub> [mg/kWh] |     | Setting* λ     |      | P <sub>F</sub> factor <sup>1)</sup> |
|---|--------------------------|-----|----------------|------|-------------------------------------|
|   | N. Gas                   | LPG | O <sub>2</sub> | λ    |                                     |
| ① | 80                       | 150 | 5 %            | 1.28 | 1.24                                |
| ② | 30                       | 60  | 7 %            | 1.46 | 1.61                                |
| ③ | 20                       | -   | 8 %            | 1.56 | 1.84                                |


<sup>1)</sup> The correction factor is based on the combustion chamber resistance (P<sub>F</sub>) at 3 % O<sub>2</sub>.  
\* Site-specific setting conditions may vary.

**NO<sub>x</sub> reference conditions:**


Air temperature = 20 °C  
Air humidity = 10 g/kg  
LHV, natural gas E = 10.35 kWh/m<sup>3</sup>  
LHV, propane = 25.89 kWh/m<sup>3</sup>  
LHV referenced to 0 °C and 1013 mbar atmospheric

- Measurement at every load point
- No averaging
- No measurement uncertainty/tolerance
- Three-pass combustion chamber

**Low-pressure supply**





**High-pressure supply**



The high-pressure regulator should have a spring selected that enables the available outlet pressure (P<sub>o</sub> = 140 / 100 / 50 mbar) to be adjusted.

**Setting pressure at the FRS regulator**

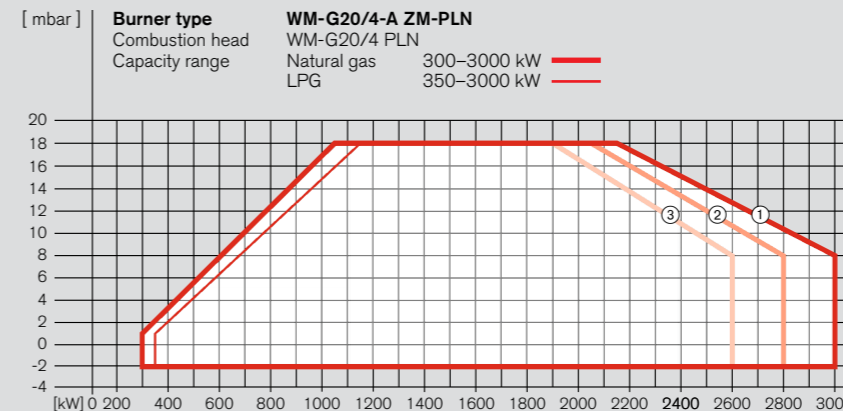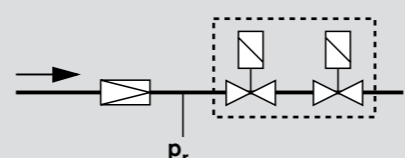

**WM-G20/4-A, version ZM-PLN**

| Burner rating [kW] | Low-pressure supply P <sub>i</sub> |        |    |    |            | High-pressure supply P <sub>o</sub> = 140 / 100 / 50 mbar |        |    |    |            | P <sub>r</sub> |                                       |    |    |            |
|--------------------|------------------------------------|--------|----|----|------------|---|--------|----|----|------------|----------------|---------------------------------------|----|----|------------|
|                    | Nominal valve train diameter       |        |    |    |            | Nominal valve train diameter                              |        |    |    |            |                | Setting pressure at the FRS regulator |    |    |            |
|                    | 1"                                 | 1 1/2" | 2" | 65 | 80 100 125 | 1"  | 1 1/2" | 2" | 65 | 80 100 125 | 1"             | 1 1/2"                                | 2" | 65 | 80 100 125 |

**Natural gas E** LHV = 10.35 kWh/m<sup>3</sup>; d = 0.606

|      |     |     |     |    |    |    |    |     |     |    |    |     |    |    |    |    |    |
|------|-----|-----|-----|----|----|----|----|-----|-----|----|----|-----|----|----|----|----|----|
| 1250 | 169 | 64  | 26  | 17 | -  | -  | -  | 124 | 65  | 25 | 46 | 32  | 12 | 8  | -  | -  | -  |
| 1450 | 225 | 84  | 34  | 21 | 16 | -  | -  | -   | 83  | 28 | 62 | 44  | 16 | 11 | 9  | -  | -  |
| 1650 | 290 | 107 | 42  | 26 | 19 | 16 | -  | -   | 103 | 32 | 80 | 56  | 21 | 14 | 12 | 10 | -  |
| 1850 | -   | 133 | 52  | 31 | 23 | 19 | 17 | -   | 125 | 36 | -  | 71  | 26 | 17 | 15 | 13 | 12 |
| 2050 | -   | 163 | 63  | 37 | 27 | 22 | 20 | -   | -   | 41 | -  | 87  | 32 | 21 | 18 | 15 | 15 |
| 2250 | -   | 195 | 74  | 44 | 32 | 25 | 23 | -   | -   | 46 | -  | 104 | 39 | 25 | 21 | 18 | 18 |
| 2500 | -   | 239 | 91  | 53 | 38 | 30 | 28 | -   | -   | 53 | -  | 128 | 48 | 31 | 26 | 22 | 22 |
| 2750 | -   | -   | 108 | 63 | 45 | 35 | 32 | -   | -   | 61 | -  | -   | 57 | 37 | 31 | 27 | 26 |
| 3000 | -   | -   | 128 | 74 | 52 | 41 | 37 | -   | -   | 70 | -  | -   | 68 | 44 | 37 | 32 | 31 |

**Natural gas LL** LHV = 8.83 kWh/m<sup>3</sup>; d = 0.641

|      |     |     |     |     |    |    |    |   |     |    |    |     |    |    |    |    |    |
|------|-----|-----|-----|-----|----|----|----|---|-----|----|----|-----|----|----|----|----|----|
| 1250 | 243 | 90  | 36  | 22  | 17 | -  | -  | - | 78  | 29 | 66 | 47  | 17 | 11 | 9  | -  | -  |
| 1450 | -   | 119 | 47  | 28  | 21 | 17 | 16 | - | 103 | 34 | -  | 63  | 23 | 15 | 13 | 11 | 11 |
| 1650 | -   | 153 | 59  | 35  | 26 | 21 | 19 | - | 132 | 39 | -  | 81  | 30 | 19 | 16 | 14 | 14 |
| 1850 | -   | 191 | 73  | 43  | 31 | 25 | 23 | - | -   | 45 | -  | 102 | 38 | 24 | 20 | 18 | 17 |
| 2050 | -   | 233 | 88  | 51  | 37 | 29 | 26 | - | -   | 52 | -  | 125 | 46 | 30 | 25 | 21 | 20 |
| 2250 | -   | -   | 105 | 60  | 43 | 34 | 31 | - | -   | 59 | -  | -   | 55 | 35 | 29 | 25 | 24 |
| 2500 | -   | -   | 128 | 73  | 52 | 40 | 36 | - | -   | 69 | -  | -   | 67 | 43 | 36 | 31 | 30 |
| 2750 | -   | -   | 153 | 87  | 61 | 47 | 43 | - | -   | 80 | -  | -   | 81 | 52 | 43 | 37 | 35 |
| 3000 | -   | -   | 181 | 102 | 71 | 55 | 50 | - | -   | 92 | -  | -   | 96 | 61 | 51 | 44 | 42 |

**LPG\*** LHV = 25.89 kWh/m<sup>3</sup>; d = 1.555

|      |     |     |    |    |    |   |   |     |     |    |     |    |    |    |    |   |   |
|------|-----|-----|----|----|----|---|---|-----|-----|----|-----|----|----|----|----|---|---|
| 1250 | 73  | 30  | -  | -  | -  | - | - | 60  | 36  | -  | 20  | 14 | -  | -  | -  | - | - |
| 1450 | 96  | 38  | -  | -  | -  | - | - | 76  | 43  | -  | 26  | 19 | -  | -  | -  | - | - |
| 1650 | 123 | 48  | 21 | -  | -  | - | - | 94  | 52  | 23 | 34  | 24 | 10 | -  | -  | - | - |
| 1850 | 153 | 59  | 25 | 17 | -  | - | - | 114 | 61  | 25 | 43  | 30 | 12 | 9  | -  | - | - |
| 2050 | 187 | 71  | 30 | 20 | 16 | - | - | 137 | 72  | 27 | 52  | 37 | 15 | 10 | 9  | - | - |
| 2250 | -   | 85  | 35 | 23 | 18 | - | - | -   | 84  | 30 | 63  | 45 | 18 | 13 | 11 | - | - |
| 2500 | -   | 104 | 43 | 27 | 21 | - | - | -   | 100 | 33 | 78  | 55 | 22 | 15 | 13 | - | - |
| 2750 | -   | 125 | 51 | 32 | 25 | - | - | -   | 118 | 37 | 94  | 67 | 27 | 19 | 16 | - | - |
| 3000 | -   | 147 | 60 | 37 | 29 | - | - | -   | 138 | 42 | 112 | 80 | 32 | 22 | 19 | - | - |

The LHV is referenced to 0 °C and 1013 mbar atmospheric pressure. All pressures are in mbar.  
\* The LPG charts are based on propane, but may also be used for butane.

Capacity graphs for gas burners certified in accordance with EN 676.

Stated ratings are based on an air temperature of 20 °C and an installation at sea level. For installations at higher altitudes, a reduction in capacity of 1 % per 100 m above sea level should be taken into account.

Stated flow pressures are based on a combustion chamber resistance of 0 mbar. The combustion chamber pressure of the heat generator must be added to the figure determined from the above chart when sizing the gas valve train.

For low-pressure supplies, EN 88-compliant regulators with safety diaphragms are used.

For high-pressure supplies, an EN 334-compliant high-pressure regulator should be selected from the following technical booklets:

- Regulators up to 4 bar, Print No. 83001202
- Regulators with safety devices, Print No. 83197902

Refer to the burner's rating plate for the maximum connection pressure.

**Maximum Operating Pressure (MOP)**

The supplier must safeguard the gas flow pressure such that it cannot exceed the MOP of the burner's gas valve train.

**Rating of low-pressure gas valve trains (LP)**

Normally, low-pressure valve trains are used for gas flow pressures up to a maximum of 300 mbar. This allows for pressure losses between the transfer station and the valve train. Furthermore, it is assumed that the transfer station utilises components (SSV, SRV, regulator) that are not of the highest class of accuracy. In individual cases, following consideration and approval by Weishaupt's headquarters, a gas flow pressure of up to 360 mbar can be approved if the appropriate conditions exist.

**Rating of high-pressure gas valve trains (LP)**

Normally, high-pressure valve trains are used for gas flow pressures above 300 mbar.

**Double gas valve assemblies**


| Screwed |            |
|---------|------------|
| R 1     | W-MF512    |
| R 1 1/2 | W-MF512    |
| R 2     | DMV525/12  |
| Flanged |            |
| DN 65   | DMV5065/12 |
| DN 80   | DMV5080/12 |
| DN 100  | DMV5100/12 |
| DN 125  | VGD40.125  |

## Example calculation

### Determining load point with regard to the required level of NO<sub>x</sub> emissions

Example:

Burner firing rate 800 kW  
 Combustion chamber resistance:  
 ● Per manufacturer, with 3 % O<sub>2</sub> 3.0 mbar  
 ⊗ For 30 mg/kWh, with 7 % O<sub>2</sub> (3 mbar • 1.61) 4.8 mbar  
 Installation altitude 0 m asl

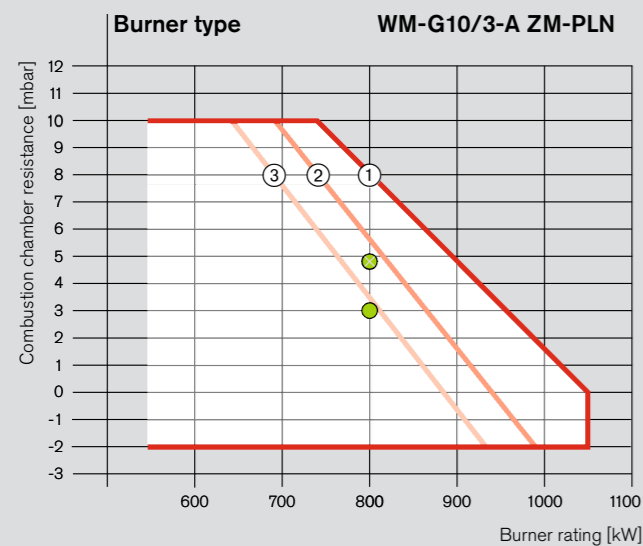

### Determining load point dependent on excess air

|   | NO <sub>x</sub> [mg/kWh] |     | Setting*       |      | P <sub>F</sub> factor <sup>1)</sup> |
|---|--------------------------|-----|----------------|------|-------------------------------------|
|   | N. Gas                   | LPG | O <sub>2</sub> | λ    |                                     |
| ① | 80                       | 150 | 5 %            | 1.28 | 1.24                                |
| ② | 30                       | 60  | 7 %            | 1.46 | 1.61                                |
| ③ | 20                       | -   | 8 %            | 1.56 | 1.84                                |

<sup>1)</sup> The correction factor is based on the combustion chamber resistance (P<sub>F</sub>) at 3 % O<sub>2</sub>.

\* Site-specific stting conditions may vary.

#### NO<sub>x</sub> reference conditions:

Air temperature = 20 °C  
 Air humidity = 10 g/kg  
 LHV, natural gas E = 10.35 kWh/m<sup>3</sup>  
 LHV, propane = 25.89 kWh/m<sup>3</sup>  
 LHV referenced to 0 °C and 1013 mbar atmospheric

- Measurement at every load point
- No averaging
- No measurement uncertainty/tolerance
- Three-pass combustion chamber

#### Note:

Boiler room ventilation must be increased appropriately to take account of the additional air required for low-NO<sub>x</sub> combustion.

## Scope of delivery

### Scope of delivery

| Description   | WM-G10 ZM-PLN | WM-G20 ZM-PLN |
|---|---------------|---------------|
| Burner housing, hinged flange, housing cover, Weishaupt burner motor, air inlet housing, fan wheel, combustion head, ignition unit, ignition cable, ignition electrodes, combustion manager with control unit, flame sensor, actuators, flange gasket, limit switch on hinged flange, fixing screws, air filter with sleeve | ●             | ●             |
| Digital combustion manager  | ●<br>○        | ●<br>○        |
| Valve proving via the combustion manager  | ●             | ●             |
| Class-A double gas valve assembly   | ●             | ●             |
| Gas butterfly valve   | ●             | ●             |
| Air pressure switch   | ●             | ●             |
| Low gas pressure switch   | ●             | ●             |
| Preset, capacity-based mixing assembly  | ●             | ●             |
| Actuators for compound regulation of fuel and air via W-FM:   |               |               |
| Air damper actuator   | ●             | ●             |
| Gas butterfly valve actuator  | ●             | ●             |
| DOL motor contactor fitted to motor <sup>1)</sup>   | ●             | ●             |
| IP 54 protection  | ●             | ●             |

EN 676 stipulates that ball valves, gas filters, and gas pressure regulators form part of the burner supply (see Weishaupt accessories list). Please enquire or see the special equipment section of this brochure for further burner executions.

- Standard
- Optional

## Order Numbers

## Special equipment WM-G10 and WM-G20, version ZM-PLN

### WM-G10 gas burners, version ZM-PLN

| Burner type | Version  | Valve train size | Order No.  |
|-------------|----------|------------------|------------|
| WM-G10/2-A  | ZM-PLN   | R ¾              | 217 124 10 |
|             |          | R 1              | 217 124 11 |
|             |          | R 1½             | 217 124 12 |
|             |          | R 2              | 217 124 13 |
|             |          | DN 65            | 217 221 14 |
| WM-G10/3-A  | ZM-PLN   | R ¾              | 217 125 10 |
|             |          | R 1              | 217 125 11 |
|             |          | R 1½             | 217 125 12 |
|             |          | DN 65            | 217 125 13 |
| WM-G10/4-A  | ZM-PLN * | R 1              | 217 126 11 |
|             |          | R 1½             | 217 126 12 |
|             |          | R 2              | 217 126 13 |
|             |          | DN 65            | 217 126 14 |
|             |          | DN 80            | 217 126 15 |
|             |          | DN 100           | 217 126 16 |

CE-PIN: CE 0085BQ0027

\* Equipped with VSD as standard

### WM-G20 gas burners, version ZM-PLN

| Burner type | Version  | Valve train size | Order No.  |
|-------------|----------|------------------|------------|
| WM-G20/2-A  | ZM-PLN   | R 1              | 217 221 11 |
|             |          | R 1½             | 217 221 12 |
|             |          | R 2              | 217 221 13 |
|             |          | DN 65            | 217 221 14 |
|             |          | DN 80            | 217 221 15 |
|             |          | DN 100           | 217 221 16 |
|             |          | DN 125           | 217 221 17 |
| WM-G20/3-A  | ZM-PLN   | R 1              | 217 222 11 |
|             |          | R 1½             | 217 222 12 |
|             |          | R 2              | 217 222 13 |
|             |          | DN 65            | 217 222 14 |
|             |          | DN 80            | 217 222 15 |
|             |          | DN 100           | 217 222 16 |
|             |          | DN 125           | 217 222 17 |
| WM-G20/4-A  | ZM-PLN * | R 1              | 217 223 11 |
|             |          | R 1½             | 217 223 12 |
|             |          | R 2              | 217 223 13 |
|             |          | DN 65            | 217 223 14 |
|             |          | DN 80            | 217 223 15 |
|             |          | DN 100           | 217 223 16 |
|             |          | DN 125           | 217 223 17 |

CE-PIN: CE 0085BQ0027

| Version ZM-PLN   |                | WM-G10 ZM-PLN | WM-G20 ZM-PLN  |
|--|----------------|---------------|----------------|
| High gas pressure switch <sup>1)</sup><br>(Screwed W-MF / DMV for low-pressure supplies)   | GW 50 A6/1     | 250 033 30    | 250 033 30     |
|  | GW 150 A6/1    | 250 033 31    | 250 033 31     |
|  | GW 500 A6/1    | 250 033 32    | 250 033 32     |
| High gas pressure switch <sup>1)</sup><br>(Flanged DMV / VGD for low-pressure supplies)  | GW 50 A6/1     | 150 017 49    | 150 017 49     |
|  | GW 150 A6/1    | 150 017 50    | 150 017 50     |
|  | GW 500 A6/1    | 150 017 51    | 150 017 51     |
| ST 18/7 and ST 18/4 plug connections (W-FM50 / 100 / 200)  |                | 250 030 22    | 250 030 22     |
| ST 18/7 plug connection (W-FM50 with KS20)   |                | 250 031 06    | 250 031 06     |
| Burner-mounted KS20 controller (W-FM50) <sup>1)</sup>  |                | 250 033 15    | 250 033 15     |
| W-FM 100 in lieu of W-FM50 <sup>1)</sup>   | burner-mounted | 250 030 74    | 250 030 74     |
|  | loose          | 250 031 45    | 250 031 43     |
| Integral load controller & analogue signal convertor for W-FM 100  |                | 110 017 18    | 110 017 18     |
| W-FM200 in lieu of W-FM50 with integral load controller, analogue signal convertor, and VSD module, with optional fuel metering              | burner-mounted | 250 030 75    | 250 030 75     |
|  | loose          | 250 030 48    | 250 030 48     |
| VSD with integral frequency convertor (W-FM50 / 200 required) <sup>2)</sup><br>incl. inductive proximity switch and LGW 10 in lieu of LGW 50 |                | 210 030 11    | 210 030 40     |
| VSD with separate frequency convertor (W-FM200 required)<br>(See accessories list for frequency convertor)                                   |                | 210 030 12    | 210 030 41     |
| WM-D90 motor with 230 V contactor and overload protection <sup>3)</sup>  |                | 250 030 86    | –              |
| WM-D112 motor with 230 V contactor and overload protection <sup>3)</sup>   |                | –             | 250 030 95     |
| ABE with Chinese-character display, loose (W-FM 100 / 200)   |                | 110 018 53    | 110 018 53     |
| Special voltage (on application only)  |                | 250 031 02    | 250 031 02     |
| 110 V control voltage  |                | 250 031 72    | 250 031 72     |
| High-temperature ceramic insulator (up to 1200 °C)   |                | 250 035 78    | 250 035 55     |
| Spacer ring with gasket (72 mm)  |                | 250 035 13    | 250 035 14     |
| Spacer ring with gasket (168 mm)   |                | –             | Please enquire |

#### Accessories

|  |                |                |
|--|----------------|----------------|
| Installation aid                             | 250 104 000 22 | –              |
| Installation aid case set for WM20           | –              | 250 204 000 62 |
| Installation aid case set for WM 10 and WM20 | 250 204 000 92 | 250 204 000 92 |

#### Country-specific executions and special voltages on application

<sup>1)</sup> Required for PED (2014/68/EU) compliance.

<sup>2)</sup> Standard on WM-G10/4 ZM-PLN and WM-G20/4 ZM-PLN.

<sup>3)</sup> The necessary motor protection can be provided either by a motor protection switch (supplied and fitted into a panel by others), or with integral motor overload protection (see special equipment).

## Technical data

| Gas burners   |                | WM-G10/2-A ZM-PLN     | WM-G10/3-A ZM-PLN     | WM-G10/4-A ZM-PLN       |
|---|----------------|-----------------------|-----------------------|-------------------------|
| Burner motor  | Weishaupt type | WM-D 90/90-2/1K0      | WM-D 90/110-2/1K5     | WM-D 90/110-2/1K9       |
| Motor power output  | kW             | 0.9                   | 1.5                   | 1.9                     |
| Nominal current   | A              | 2.2                   | 3.2                   | 3.7                     |
| Nominal frequency   | Hz             | 50                    | 50                    | 50                      |
| Motor protection switch or overload protection with motor prefusing <sup>1)</sup> | type (e.g.)    | PKE12/XTU - 4         | PKE12/XTU - 4         | PKE12/XTU - 4           |
|   | A minimum      | 10 A gG/T (by others) | 16 A gG/T (by others) | 16 A gG/T (by others)   |
| Speed   | rpm            | 2900 at 50 Hz         | 2900 at 50 Hz         | 3120 at 55 Hz (with FC) |
| Combustion manager Prefusing  | type           | W-FM 50/ 100          | W-FM 50/ 100          | W-FM 50/ 100            |
|   | A              | 16 A B                | 16 A B                | 16 A B                  |
| Flame monitoring  | type           | ION                   | ION                   | ION                     |
| Air damper/ gas actuator  | type           | STE 50/ SQM 45        | STE 50/ SQM 45        | STE 50/ SQM 45          |
| NOx Class per EN 676  | ZM-PLN         | 3                     | 3                     | 3                       |
| Mass (excl. double gas valve and fittings)  | kg             | approx. 74            | approx. 75            | approx. 75              |

| Gas burners   |                | WM-G20/2-A ZM-PLN     | WM-G20/3-A ZM-PLN     | WM-G20/4-A ZM-PLN       |
|---|----------------|-----------------------|-----------------------|-------------------------|
| Burner motor  | type Weishaupt | WM-D 112/140-2/3K0    | WM-D 112/170-2/4K5    | WM-D 112/170-2/7K0      |
| Motor power output  | kW             | 3.0                   | 4.5                   | 7.0                     |
| Nominal current   | A              | 6.5                   | 9.2                   | 15.0                    |
| Nominal frequency   | Hz             | 50                    | 50                    | 50                      |
| Motor protection switch or overload protection with motor prefusing <sup>1)</sup> | type (e.g.)    | PKE12/XTU-12          | PKE12/XTU-12          | PKE32/XTU-32            |
|   | A minimum      | 25 A gG/T (by others) | 35 A gG/T (by others) | 25 A gG/T (by others)   |
| Speed   | rpm            | 2950 at 50 Hz         | 2930 at 50 Hz         | 3520 at 60 Hz (with FC) |
| Combustion manager Prefusing  | type           | W-FM 50               | W-FM 50               | W-FM 50                 |
|   | A              | 16 AB                 | 16 AB                 | 16 AB                   |
| Flame monitoring  | type           | ION                   | ION                   | ION                     |
| Air damper/ gas actuator  | type           | STE 50/SQM45          | STE 50/SQM45          | STE 50/SQM45            |
| NOx Class per EN 676  | ZM-PLN         | 3                     | 3                     | 3                       |
| Mass (excl. double gas valve and fittings)  | kg             | approx. 95            | approx. 100           | approx. 110             |

<sup>1)</sup> The necessary motor protection can be provided either by a motor protection switch (supplied and fitted into a panel by others) or with integral motor overload protection (see special equipment).

### Voltages and frequencies:


The burners are equipped as standard for three-phase alternating current, 400 V, 3 ~, 50 Hz. Other voltages and frequencies are available on application.

### Standard burner motor:

Insulation Class F, IP 55 protection. IE3 Premium Efficiency.

## Fuel systems

### Low-pressure gas supply (LP)

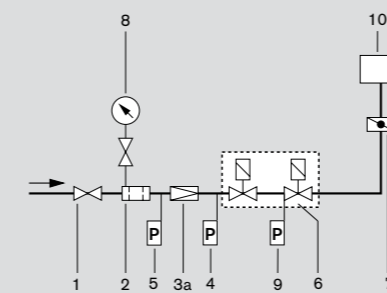

### Layout of the valve train

On boilers with hinged doors, the valve train must be mounted on the opposite side to the boiler-door hinges.

### Compensator

To enable a tension free mounting of the valve train, the fitting of a compensator is strongly recommended.


### Break points in the valve train

Break points in the valve train should be provided to enable the door of the heat generator to be swung open. The main gas line is best separated at the compensator.

### Support of the valve train

The valve train should be properly supported in accordance with the site conditions. Please refer to the Weishaupt accessories list for various valve train support components.

### High-pressure gas supply (HP)

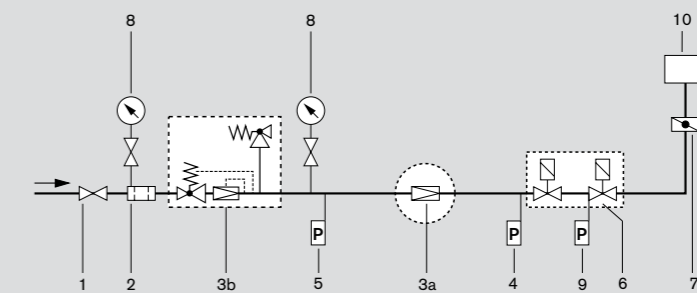

### Gas meter

A gas meter must be installed to measure gas consumption during commissioning and servicing.

### Optional thermal shutoff (when required by local regulations)

Integrated into the ball valve of screwed valve trains. A separate component with HTB seals fitted before the ball valve on flanged valve trains.

### Use of high-pressure regulators

A high-pressure regulator should be selected from the following technical booklets:

- Regulators up to 4 bar, Print No. 83001202
- Regulators with safety devices, Print No. 83197902


For PLN burners, the high-pressure regulator selected (3b) is used as a pressure reducing station with safety functions. The high-pressure regulator should be set for the maximum outlet pressure calculated, while the load-specific regulated pressure is set on the low-pressure regulator (3a).

- Ball valve \*
- Gas filter \*
- Pressure regulator (LP) \*
- Pressure regulator (HP) \*
- High gas pressure switch \*
- Low gas pressure switch
- Double gas valve assembly
- Gas butterfly valve
- Pressure gauge with push-button valve \*
- Valve-proving pressure switch
- Burner


\* Not included in burner price

# Dimensions

WM-G10 gas burners, version ZM-PLN

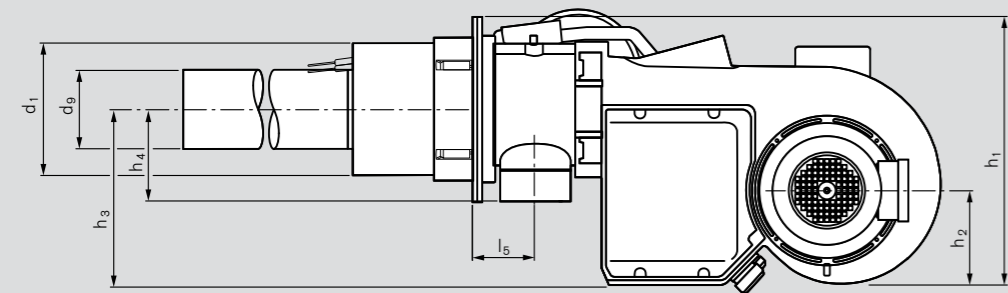


Mounting-plate drilling dimensions




WM-G10 ZM-PLN



WM-G20 gas burners, version ZM-PLN

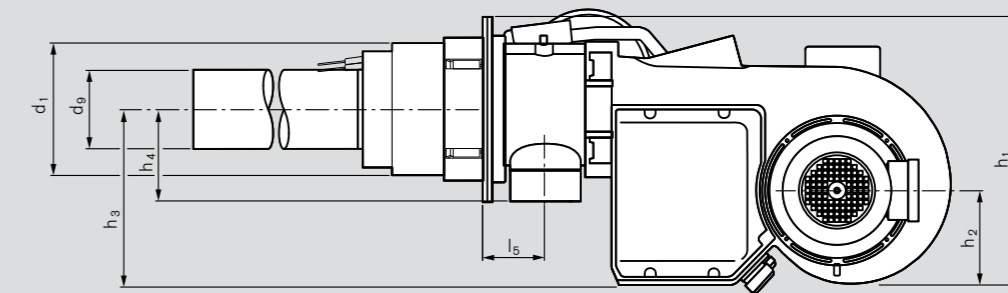

Mounting-plate drilling dimensions



WM-G20 ZM-PLN

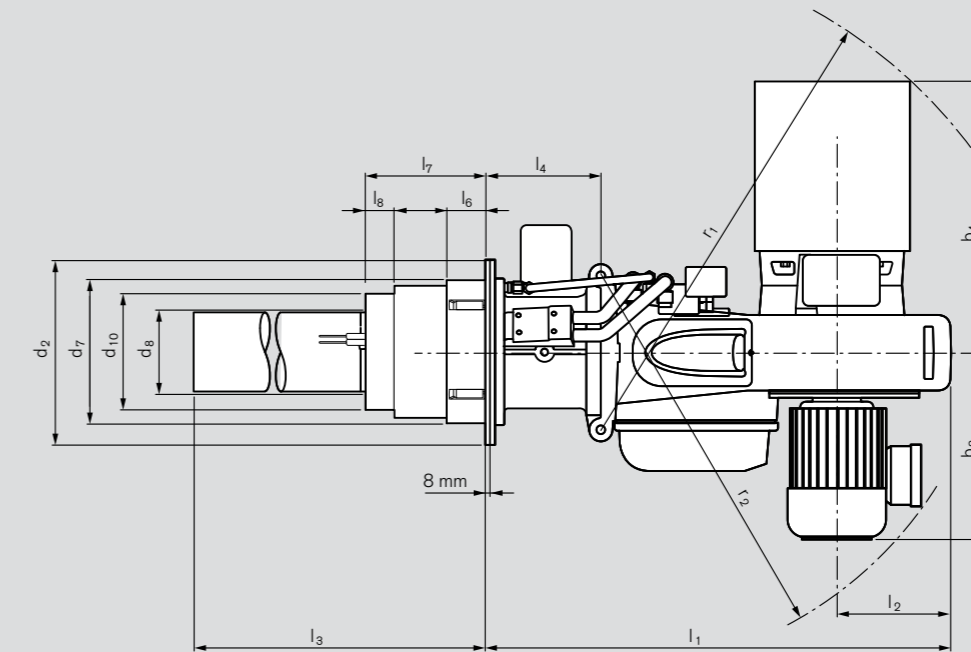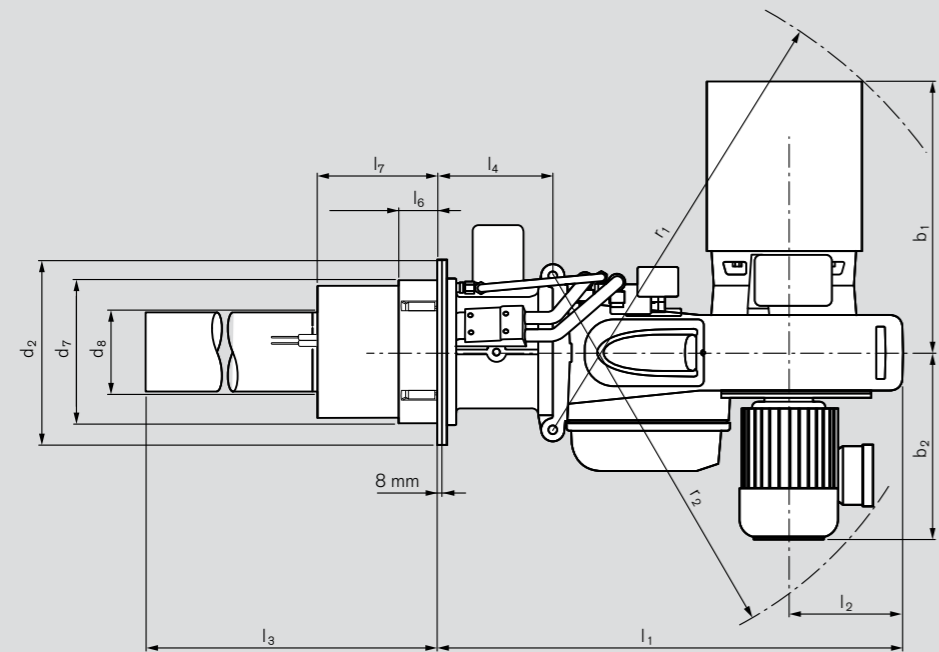

| Burner type       | Dimensions in mm |                |                |                |                |                |                |                |                |                |                |                 |                |
|-------------------|------------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|-----------------|----------------|
|                   | l <sub>1</sub>   | l <sub>2</sub> | l <sub>3</sub> | l <sub>4</sub> | l <sub>5</sub> | l <sub>6</sub> | l <sub>7</sub> | b <sub>1</sub> | b <sub>2</sub> | h <sub>1</sub> | h <sub>2</sub> | h <sub>3</sub>  | h <sub>4</sub> |
| WM-G10/2-A ZM-PLN | 833              | 205            | 834            | 208            | 108            | 68             | 213            | 481            | 307*           | 478            | 167            | 313             | 162            |
| WM-G10/3-A ZM-PLN | 833              | 205            | 1198           | 208            | 108            | 68             | 213            | 481            | 335*           | 478            | 167            | 313             | 162            |
| WM-G10/4-A ZM-PLN | 833              | 205            | 1198           | 208            | 108            | 68             | 213            | 481            | 346            | 478            | 167            | 313             | 162            |
|                   | r <sub>1</sub>   | r <sub>2</sub> | d <sub>1</sub> | d <sub>2</sub> | d <sub>3</sub> | d <sub>4</sub> | d <sub>5</sub> | d <sub>6</sub> | d <sub>7</sub> | d <sub>8</sub> | d <sub>9</sub> | d <sub>10</sub> |                |
| WM-G10/2-A ZM-PLN | 826              | 682            | 234            | 330            | M12            | 260            | 298            | 255            | 253            | 147            | 145            |                 |                |
| WM-G10/3-A ZM-PLN | 826              | 698            | 234            | 330            | M12            | 260            | 298            | 255            | 253            | 147            | 145            |                 |                |
| WM-G10/4-A ZM-PLN | 826              | 698            | 234            | 330            | M12            | 260            | 298            | 255            | 253            | 147            | 145            |                 |                |

\* Projection of frequency convertor approx. 20 mm


| Burner type       | Dimensions in mm |                |                |                |                |                |                |                |                |                |                |                 |                |                |
|-------------------|------------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|-----------------|----------------|----------------|
|                   | l <sub>1</sub>   | l <sub>2</sub> | l <sub>3</sub> | l <sub>4</sub> | l <sub>5</sub> | l <sub>6</sub> | l <sub>7</sub> | l <sub>8</sub> | b <sub>1</sub> | b <sub>2</sub> | h <sub>1</sub> | h <sub>2</sub>  | h <sub>3</sub> | h <sub>4</sub> |
| WM-G20/2-A ZM-PLN | 1010             | 254            | 1023           | 238            | 128            | 78             | 213            | 55             | 545            | 424*           | 625            | 217             | 400            | 226            |
| WM-G20/3-A ZM-PLN | 1010             | 254            | 1423           | 238            | 128            | 78             | 213            | 55             | 545            | 464*           | 625            | 217             | 400            | 226            |
| WM-G20/4-A ZM-PLN | 1010             | 254            | 1623           | 238            | 128            | 78             | 213            | 55             | 545            | 521            | 625            | 217             | 400            | 226            |
|                   | r <sub>1</sub>   | r <sub>2</sub> | d <sub>1</sub> | d <sub>2</sub> | d <sub>3</sub> | d <sub>4</sub> | d <sub>5</sub> | d <sub>6</sub> | d <sub>7</sub> | d <sub>8</sub> | d <sub>9</sub> | d <sub>10</sub> |                |                |
| WM-G20/2-A ZM-PLN | 1040             | 869            | 335            | 450            | M12            | 370            | 400            | 365            | 360            | 251            | 248            | 315             |                |                |
| WM-G20/3-A ZM-PLN | 1040             | 883            | 335            | 450            | M12            | 370            | 400            | 365            | 360            | 251            | 248            | 315             |                |                |
| WM-G20/4-A ZM-PLN | 1040             | 951            | 335            | 450            | M12            | 370            | 400            | 365            | 360            | 251            | 248            | 315             |                |                |

\* Projection of frequency convertor approx. 20 mm

# Minimum combustion chamber sizes

# Dimensions for inserting and withdrawing the burner tube

Heat generator without spacer ring

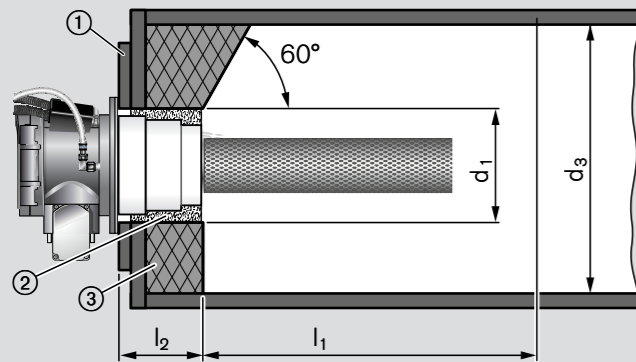


**Dimensions**

**WM-G10 ZM-PLN**


- d<sub>1</sub> Minimum boiler aperture without spacer ring..... 260 mm
- d<sub>2</sub> Minimum boiler aperture with spacer ring..... 244 mm
- d<sub>3</sub> Minimum combustion chamber diameter ..... 350 mm
- l<sub>1</sub> Minimum combustion chamber length
  - WM 10/2..... 840 mm
  - WM 10/3..... 1200 mm
  - WM 10/4..... 1200 mm
- l<sub>2</sub> Maximum boiler door depth, including refractory / insulation,
  - without spacer ring..... 220 mm
  - with spacer ring and gasket..... 145 mm

**WM-G20 ZM-PLN**

- d<sub>1</sub> Minimum boiler aperture without spacer ring..... 370 mm
- d<sub>2</sub> Minimum boiler aperture with 72 mm spacer ring ..... 345 mm
- d<sub>3</sub> Minimum boiler aperture with 168 mm spacer ring..... 320 mm
- d<sub>3</sub> Minimum combustion chamber diameter ..... 450 mm
- l<sub>1</sub> Minimum combustion chamber length
  - WM 20/2..... 1230 mm
  - WM 20/3..... 1630 mm
  - WM 20/4..... 1830 mm
- l<sub>2</sub> Maximum boiler door depth, including refractory / insulation,
  - without spacer ring..... 220 mm
  - with 72 mm spacer ring and gasket ..... 145 mm
  - with 168 mm spacer ring and gasket ..... 55 mm

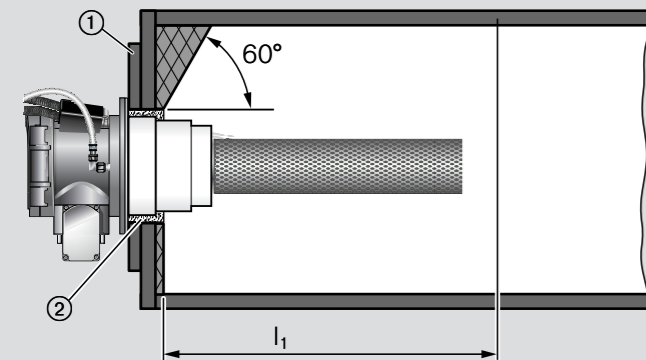

Heat generator with spacer ring

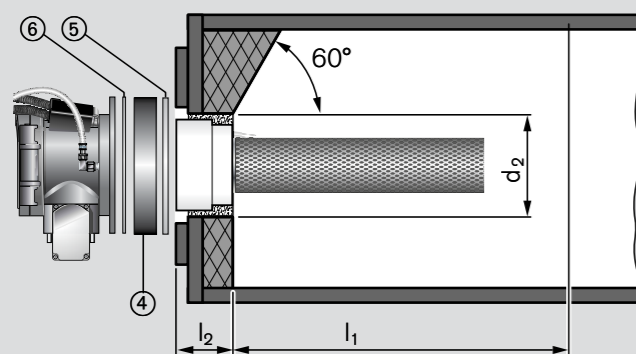


**Legend**


- ① Mounting plate  
(WM-G20 ZM-PLN: Depth ≥ 8 mm for installations with spacer ring)
- ② Aperture
- ③ Refractory / insulation
- ④ 74 mm spacer ring with gasket, WM-G10 ZM-PLN  
72 mm spacer ring with gasket, WM-G20 ZM-PLN  
168 mm spacer ring with gasket, WM-G20 ZM-PLN  
(Optional for boilers with narrow burner apertures)
- ⑤ 8 mm flange gasket
- ⑥ Gasket

Note:  
The boiler door refractory / insulation may be tapered (≥ 60°).


WM-G ZM-PLN without spacer ring

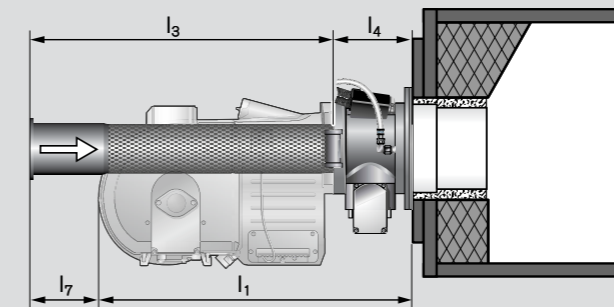


Installation aid – minimum clearance without spacer ring

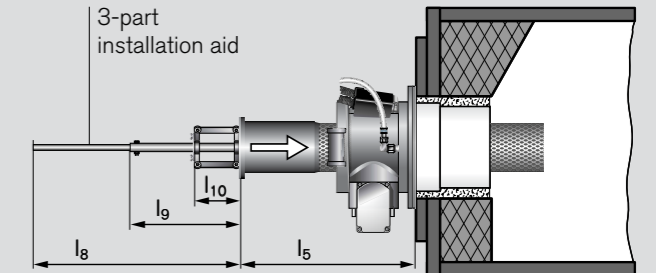

WM-G ZM-PLN with spacer ring

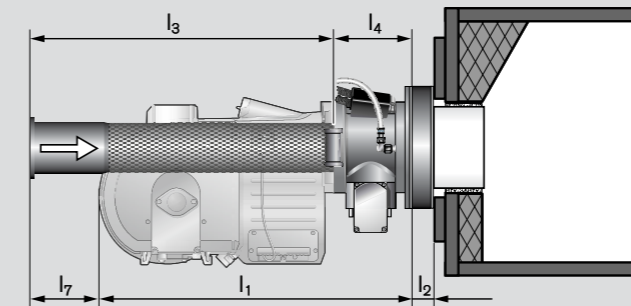

Installation aid – minimum clearance with spacer ring

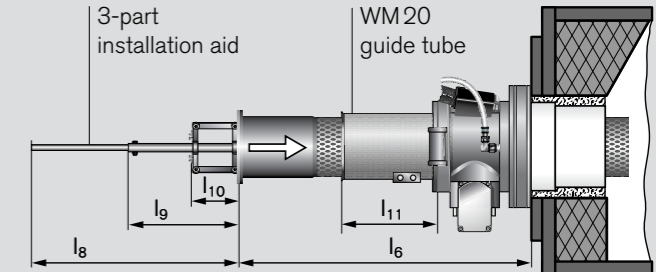

| Burner type              | Dimensions in mm |                |                |                |                |                |                |                |                |                 |                 |
|--------------------------|------------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|-----------------|-----------------|
|                          | l <sub>1</sub>   | l <sub>2</sub> | l <sub>3</sub> | l <sub>4</sub> | l <sub>5</sub> | l <sub>6</sub> | l <sub>7</sub> | l <sub>8</sub> | l <sub>9</sub> | l <sub>10</sub> | l <sub>11</sub> |
| <b>WM-G10/2-A ZM-PLN</b> | 833              | 74             | 852            | 208            | 1060           | 1134           | 227            | 585            | 305            | 155             | -               |
| <b>WM-G10/3-A ZM-PLN</b> | 833              | 74             | 1216           | 208            | 1424           | 1498           | 591            | 585            | 305            | 155             | -               |
| <b>WM-G10/4-A ZM-PLN</b> | 833              | 74             | 1216           | 208            | 1424           | 1498           | 591            | 585            | 305            | 155             | -               |
| <b>WM-G20/2-A ZM-PLN</b> | 1010             | 72             | 1044           | 238            | 1592           | 1664           | 582            | 585            | 305            | 155             | 310             |
| <b>WM-G20/3-A ZM-PLN</b> | 1010             | 72             | 1444           | 238            | 1992           | 2064           | 982            | 585            | 305            | 155             | 310             |
| <b>WM-G20/4-A ZM-PLN</b> | 1010             | 72             | 1640           | 238            | 2188           | 2260           | 1178           | 585            | 305            | 155             | 310             |



# Contact Us



Maximising Energy Efficiencies for a Sustainable Future

[admin@egl.com.au](mailto:admin@egl.com.au)

[www.environmental.com.au](http://www.environmental.com.au)

03 9541 8699

## Office Locations



### Melbourne

Tomlinson Energy Services  
Suite 2.01 | Level 2  
315 Ferntree Gully Road  
Mount Waverley VIC 3149

P: 03 8560 0416

E: [energyservice.melbourne@tomlinsonenergy.com.au](mailto:energyservice.melbourne@tomlinsonenergy.com.au)

### Sydney

Tomlinson Energy Services  
A2, 26 Power Road  
Seven Hills NSW 2417

P: 02 9681 4177

E: [energyservice.sydney@tomlinsonenergy.com.au](mailto:energyservice.sydney@tomlinsonenergy.com.au)

### Brisbane

Tomlinson Energy Services  
1/48 Commerce Circuit  
Yatala QLD 4207

P: 07 3462 0159

E: [energyservice.brisbane@tomlinsonenergy.com.au](mailto:energyservice.brisbane@tomlinsonenergy.com.au)

### South Australia

Tomlinson Energy Services  
26 Phillips Street  
Thebarton SA 5031

P: 08 8297 9688

E: [energyservice.adelaide@tomlinsonenergy.com.au](mailto:energyservice.adelaide@tomlinsonenergy.com.au)

### Western Australia

Tomlinson Energy Services  
40 Sorbonne Crescent  
Canning Vale WA 6155

P: 08 9455 5511

E: [energyservice.perth@tomlinsonenergy.com.au](mailto:energyservice.perth@tomlinsonenergy.com.au)



**The Environmental  
Group Limited**  
*Engineering a Sustainable Future*